


New Ben Lomond to Terminal structures on left



Stringing Optical Ground Wire on Ben Lomond to Terminal



Angle Structure installation Ben Lomond to Terminal

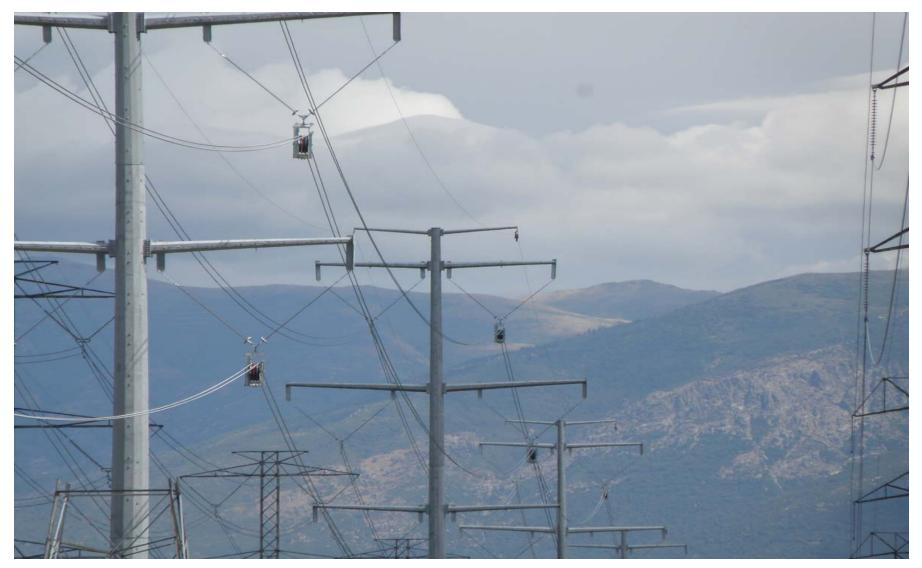

Conductor installation in Ben Lomond to Terminal




Populus substation (Downey Idaho) – Sized to integrate Populus Terminal, existing Bridger West lines (from Wyoming) and future Gateway West 500kV line (from Wyoming)



Populus substation (Downey Idaho) – Placing 345kV circuit breaker



Populus to Ben Lomond – I-15 crossing south of Populus substation

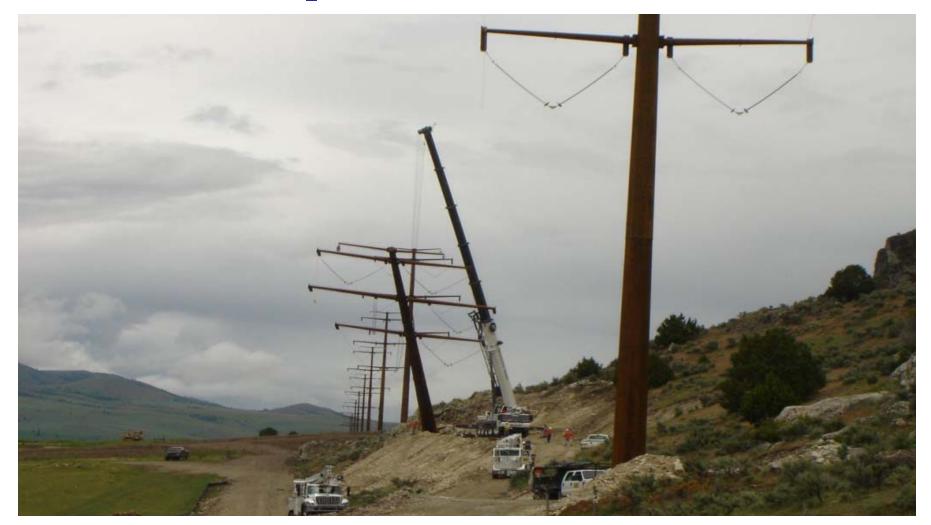

Populus to Ben Lomond – Pole setting in Idaho