


# Critical Load Area



Future 345kV line  
Future 500 kV line

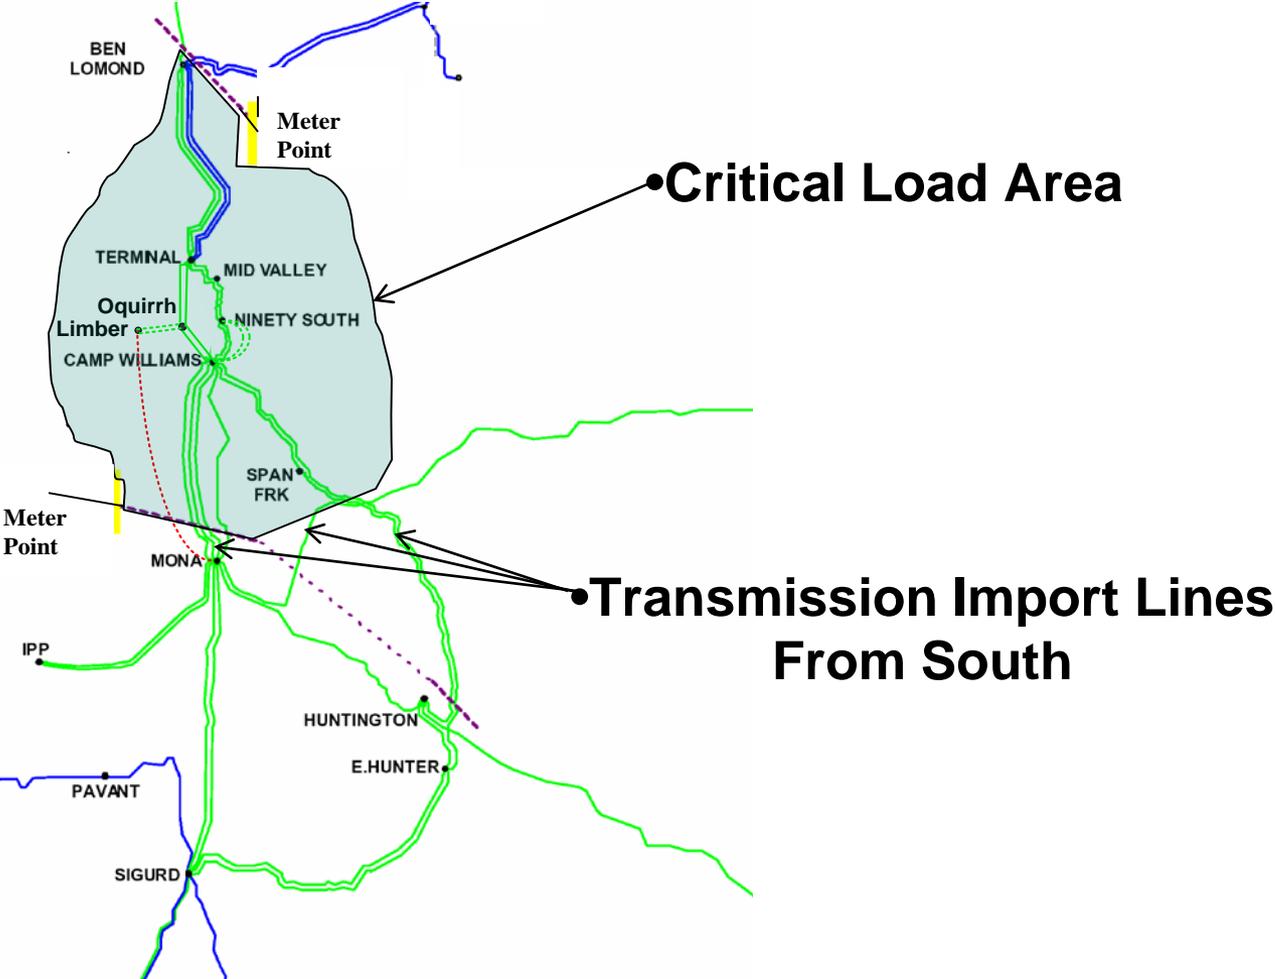