



201 South Main, Suite 2300
Salt Lake City, Utah 84111

January 7, 2011

***VIA ELECTRONIC FILING
AND HAND DELIVERY***

Public Service Commission of Utah
Heber M. Wells Building, 4th Floor
160 East 300 South
Salt Lake City, UT 84114

Attention: Julie P. Orchard
Commission Secretary

Re: In the Matter of the Application of ROCKY MOUNTAIN POWER for Approval of the Pole Attachment Agreement between PacifiCorp and CentraCom Interactive.

Rocky Mountain Power hereby submits for filing to the Public Service Commission of Utah ("Commission") an original and five (5) copies of its Application and the associated contract and exhibits in this matter.

Rocky Mountain Power apologizes for the delay in submitting this contract for approval. The contract was finalized just after the Commission amended the scheduling order in Docket 10-035-43; meeting the dates in that scheduling order took precedence over filing this contract. This Application was intended to be filed promptly after meeting the Commission's requirements, but the task was inadvertently delayed. CentraCom Interactive is an existing customer that obtained assets from another telecommunications company, which was also an existing joint use customer of Rocky Mountain Power. CentraCom Interactive requested a new contract, rather than seek approval of an assignment, for consistency. The parties continue to engage in good faith negotiations to resolve issues related to terms of the prior contracts and Rocky Mountain Power has treated CentraCom Interactive as an Existing Customer pursuant to the Commission's Order issued October 5, 2009 in Docket 09-035-52.

Although the contract as executed contains a confidentiality clause, Rocky Mountain Power obtained a waiver of the confidentiality clause subsequent to the contract execution to allow the contract to be filed with the Commission without placing it under seal.

Please contact Barbara Ishimatsu at (801) 220-4640 if you have any questions.

Very Truly,

Jeffrey K. Larsen
Vice President, Regulation

cc: Service List

CERTIFICATE OF SERVICE

I hereby certify that I caused a true and correct copy of the foregoing **APPLICATION FOR APPROVAL OF THE POLE ATTACHMENT AGREEMENT BETWEEN PACIFICORP AND CENTRACOM INTERACTIVE** to be served upon the following by electronic mail or U.S. postage to the addresses shown below on January 7, 2011:


Kira M. Slawson
Blackburn & Stoll, LC
257 East 200 South, Suite 800
Salt Lake City, UT 84111-2048
KiraM@blackburn-stoll.com

Paul Proctor
Office of Consumer Services
Heber M. Wells Bldg., Fifth Floor
160 East 300 South
Salt Lake City, UT 84111
pproctor@utah.gov

Cheryl Murray
Dan Gimble
Michele Beck
Office of Consumer Services
160 East 300 South, 2nd Floor
Salt Lake City, UT 84111
cmurray@utah.gov
dgimble@utah.gov
mbeck@utah.gov

Dennis Miller
William Powell
Christopher Parker
Division of Public Utilities
Heber M. Wells Building
160 East 300 South, 4th Floor
Salt Lake City, UT 84111
dennismiller@utah.gov
wpowell@utah.gov
chrisparker@utah.gov

Michael Ginsberg
Patricia Schmid
Assistant Attorney General
Utah Division of Public Utilities
Heber M. Wells Bldg., Fifth Floor
160 East 300 South
Salt Lake City, UT 84111
mginsberg@utah.gov
pschmid@utah.gov



Ariel Son
Coordinator, Regulatory Operations

Daniel E. Solander (11467)
Barbara Ishimatsu (10945)
Rocky Mountain Power
201 South Main Street, Suite 2300
Salt Lake City, Utah 84111
Telephone No. (801) 220-4640
Facsimile No. (801) 220-3299
Daniel.solander@pacificorp.com
Barbara.ishimatsu@pacificorp.com

Attorneys for Rocky Mountain Power

BEFORE THE PUBLIC SERVICE COMMISSION OF UTAH

In the Matter of the Application of
ROCKY MOUNTAIN POWER for Approval
of the Pole Attachment Agreement between
PacifiCorp and CentraCom Interactive

DOCKET No. 11-035-____

**APPLICATION OF ROCKY
MOUNTAIN POWER**

PacifiCorp, doing business in Utah as Rocky Mountain Power (“Rocky Mountain Power” or “Company”) respectfully requests an order under Utah Admin. Code R746-345-3 approving a Pole Attachment Agreement (the “Agreement”) between PacifiCorp and Central Utah Telephone, Inc., Skyline Telecom, Bear Lake Communications, Inc. and Central Telecom Services LLC (collectively d/b/a “CentraCom Interactive”), dated August 10, 2010. Each of Rocky Mountain Power and CentraCom Interactive are referred to as a “Party” and together referred to as the “Parties.”

In support of its Application, Rocky Mountain Power states as follows:

1. Rocky Mountain Power is a public utility in the state of Utah and is subject to the jurisdiction of the Commission with regard to its rates and service. As a public utility that permits attachments to its poles by an attaching entity, Rocky Mountain Power is obligated to provide that service pursuant to the requirements in Utah Admin. Rules, R.746-345 governing pole attachments. Rocky Mountain has previously submitted for Commission approval non-

reciprocal pole attachment agreements with TCG Utah and Leavitt Group Enterprises (approved by the Commission in Docket Nos. 09-035-52 and 10-035-01, respectively), as well as with Alliant Techsystems and Break Away Wireless (Docket Nos. 10-035-59 and 10-035-61, respectively).

2. Communications regarding this Application should be addressed to:

By e-mail (preferred): datarequest@pacificorp.com
Dave.taylor@pacificorp.com
Barbara.ishimatsu@pacificorp.com

By mail: Data Request Response Center
Rocky Mountain Power
825 NE Multnomah St., Suite 800
Portland, OR 97232

Dave Taylor
Rocky Mountain Power
201 South Main, Suite 2300
Salt Lake City, UT 84111
Telephone: (801) 220-2923

Barbara Ishimatsu
Rocky Mountain Power
201 South Main Street, Suite 2300
Salt Lake City, UT 84111
Telephone: (801) 220-4640

3. Under R746-345-3(B) (1), the parties to pole attachment contracts “may voluntarily negotiate an alternative contract . . . [and] shall submit the negotiated contract to the Commission for approval.” The Agreement was voluntarily negotiated between Rocky Mountain Power and CentraCom Interactive. The Agreement negotiated between Rocky Mountain Power and CentraCom Interactive is substantively identical to the pole attachment agreement with Break Away Wireless approved in Docket No. 10-035-61.

4. The Agreement negotiated between Rocky Mountain Power and CentraCom Interactive contains terms that differ from the agreement approved by the Commission in Docket 04-999-03 known as the “Safe Harbor”. While Rocky Mountain Power opened negotiations with a draft agreement that nearly mirrored the Safe Harbor agreement, several provisions differ from the Safe Harbor terms based on negotiations with CentraCom Interactive and with other attaching parties. As noted in earlier dockets, the differences are as follows:

a. The contact rental set forth in the Agreement was calculated using Rocky Mountain Power’s Tariff approved as Electric Service Schedule No. 4.

b. The Agreement reflects the non-reciprocal relationship between the Parties in contrast to the reciprocal relationship contemplated by the Safe Harbor agreement.

c. Rocky Mountain Power modified the sections governing the application process to match its existing business practices. To reduce uncertainty for attaching entities, Rocky Mountain Power agreed to enumerate the grounds upon which it may reject an application for attachment and delineated specific events of default. Additionally, Rocky Mountain Power agreed to provide an approval or denial of applications sooner than under the Safe Harbor, within 45 days of Rocky Mountain Power’s receipt of the application, as compared to up to 90 days as allowed under the Safe Harbor. Next, while rent begins to accrue sooner than under the Safe Harbor, CentraCom Interactive is allowed a longer period to pay outstanding invoices, from 30 days, per the Safe Harbor, to 45 days. Furthermore, CentraCom Interactive received a much longer time to complete installation of Attachments – 180 days instead of 90 days -- and may extend this period without resubmitting an application or paying another fee as envisioned by the Safe Harbor. In addition, if a CentraCom Interactive does not accept the cost to accommodate its continued attachment when requested to relocate, the CentraCom Interactive must remove the

attachment 10 days sooner than provided in the Safe Harbor which allows Rocky Mountain Power to accommodate relocations faster. In addition, the Agreement contains modified Termination requirements, allowing each Party to terminate the Agreement upon ninety (90) days written notice to the other, within which time CentraCom Interactive must remove its attachments. As an additional benefit, Rocky Mountain Power agreed to allow CentraCom Interactive to assign its contract without the consent of Rocky Mountain Power, within certain parameters. Furthermore, the Agreement removes the express prohibition on use of Rocky Mountain Power easements and rights of way, but allows Rocky Mountain Power to require written documentation of compliance with third party consents, permits, licenses or grants.

d. Several provisions were modified to reflect regulatory requirements, industry practice, or National Electric Safety code requirements.

e. The Agreement contains the Company's updated terms regarding indemnification, credit and insurance, as well as limitations of liability and warranties, which terms are reflected throughout the Agreement. CentraCom Interactive must maintain commercial general liability insurance at a higher limit than provided in the Safe Harbor, maintain umbrella liability insurance to cover any shortfalls in other coverage, and maintain business interruption insurance. These increased requirements reflect the changes to economic conditions since 2004.

f. Some provisions of the Safe Harbor have been relocated to another place in the agreement, consolidated or otherwise clarified for stylistic purposes. Minor changes from the Safe Harbor agreement are simply non-substantive wording changes. A table of contents was added for convenience of the reader.


5. The Agreement represents the parties' agreed-to terms and conditions for CentraCom Interactive's attachments to Rocky Mountain Power's poles in Utah.

6. The Parties have agreed to waive the confidentiality clause for the purposes of filing the contract for approval.

WHEREFORE, Rocky Mountain Power respectfully requests that the Commission issue an order approving the Agreement submitted herewith and finding the terms and conditions of the Agreement to be just and reasonable and in the public interest.

DATED this 7th day of January 2011.

Respectfully submitted,

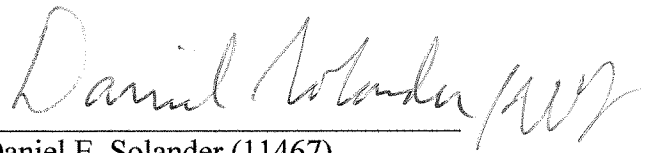A handwritten signature in dark ink, appearing to read "Daniel Solander" followed by a stylized monogram or initials.

Daniel E. Solander (11467)
Barbara Ishimatsu (10945)
Rocky Mountain Power
201 South Main Street, Suite 2300
Salt Lake City, Utah 84111
Telephone No. (801) 220-4640
Facsimile No. (801) 220-3299
Daniel.solander@pacificorp.com
Barbara.ishimatsu@pacificorp.com

Attorneys for Rocky Mountain Power

POLE ATTACHMENT AGREEMENT

BETWEEN

PACIFICORP

AND

CENTRAL UTAH TELEPHONE, INC., SKYLINE TELECOM, BEAR LAKE
COMMUNICATIONS, INC. AND CENTRAL TELCOM SERVICES LLC, INC.,
D.B.A. CENTRACOM INTERACTIVE

THIS POLE ATTACHMENT AGREEMENT (this "Agreement"), dated as of _____, 2010 is entered into by and between PACIFICORP, an Oregon Corporation, d.b.a. PACIFIC POWER and ROCKY MOUNTAIN POWER, hereinafter "PacifiCorp," and CENTRAL UTAH TELEPHONE, INC., SKYLINE TELECOM, BEAR LAKE COMMUNICATIONS, INC. AND CENTRAL TELCOM SERVICES LLC, INC. D.B.A. CENTRACOM INTERACTIVE, hereinafter "Licensee," a UTAH CORPORATION

WHEREAS, PacifiCorp is engaged in the business of providing electric service to customers in certain areas within the state of Utah; and

WHEREAS, Licensee conducts its communications business in a number of the same areas within Utah; and

WHEREAS, Licensee desires to attach its communications Equipment to Poles owned by PacifiCorp within the state of Utah and PacifiCorp desires to grant Licensee access to such Poles in accordance with the terms and conditions of this Agreement.

NOW, THEREFORE, the Parties agree as follows:

ARTICLE I. DEFINITIONS

The following terms, when used herein with initial capitalization, whether in the singular or in the plural, shall have the meanings specified in this Article I:

"Attachment" means each individual contact of Equipment to a Pole.

"Audit" means a periodic effort to collect information through Inspection by PacifiCorp of all or any number of Poles that may have Licensee Attachments.

"Business Days" means days other than a Saturday, Sunday, or state or federal holiday when banks are authorized to be closed.

"Commission" means the State of Utah Public Service Commission.

"Distribution Construction Standards" means the current PacifiCorp Distribution Construction Standards attached hereto as Exhibit C, and any subsequent revisions thereof.

“Electronic Notification System” or “ENS” means the electronic system, or combination of electronic systems designated by PacifiCorp in its sole discretion, the Licensee may utilize to submit applications for permission to attach, relocate, or remove its Equipment, and complete any other notifications as required under the terms of this Agreement.

“Equipment” means cables, wires, conductors, fiber optics, insulators, connectors, fasteners, transformers, capacitors, switches, batteries, amplifiers, power supplies, devices, structures, materials, machines, appurtenances, articles, or apparatus of any sort, whether electrical or physical in nature, or otherwise, including without limitation all support equipment such as guy wires, anchors, anchor rods, grounds, and other accessories. Equipment specifically excludes Licensee wireless communication devices.

“Fee Schedule” means the fees set forth in Exhibit B attached hereto.

“Inspection” means examination by PacifiCorp of its Poles and all proposed or existing Attachments for the purpose of verifying the number and location of all Attachments and any other Pole-mounted Equipment of Licensee, or determining whether Licensee is in compliance with the terms of this Agreement.

“Make-ready Work” means all engineering, Inspection, design, planning, construction, or other work necessary, in PacifiCorp’s reasonable judgment, to prepare PacifiCorp’s Poles for the installation of Licensee’s Attachments, including without limitation, work related to transfers, rearrangements and replacements of existing Poles or Equipment, and/or the addition of new Poles or Equipment.

“National Electrical Safety Code” or “NESC” means the current edition published by the Institute of Electrical and Electronics Engineers, Inc., as may be amended or supplemented from time to time.

“Non-recurring Charges” means amounts payable by Licensee under this Agreement other than rental charges, including, without limitation: application fees; charges to correct nonconforming Equipment; charges for Make-ready Work; costs of mitigating interference with PacifiCorp’s equipment; Pole replacements or installation for Licensee’s benefit; cost of anchors and guys; removal or relocation of Attachments or other Equipment; liability for damage to Equipment; sanctions; pre and post construction Inspections of new Attachments, modified Attachments, Pole transfers, requests for special Inspections; certain tax liabilities; late payment interest; and any other costs incurred by PacifiCorp that are caused by or attributable to Licensee’s Equipment.

“Party” means PacifiCorp or Licensee, as the context requires; “Parties” means PacifiCorp and Licensee.

“Periodic Inspection” means any inspection done at the option of PacifiCorp to review the safety and integrity of its Poles. Periodic Inspections do not include pre-construction activities, post construction inspections or Audits.

“Pole” means any pole owned by PacifiCorp that is designed to carry distribution.

ARTICLE II. SCOPE OF AGREEMENT

Section 2.01 Grant of License; Geographic Scope

In accordance with the terms and conditions of this Agreement, PacifiCorp hereby grants Licensee the non-exclusive right to attach its Equipment pertaining directly to its business purpose as defined in Section 2.02. Licensee Attachments hereunder shall be limited to PacifiCorp's Poles within the state of Utah.

Attachments shall not be permitted by PacifiCorp on poles which are not designed to accommodate distribution. Nothing in this Agreement shall be construed to obligate PacifiCorp to grant Licensee permission to use any particular Pole or Poles.

Section 2.02 Attachments; Purpose

Licensee's use of Poles shall be confined to the Attachments which PacifiCorp may give Licensee prior written permission to install for the sole purpose of providing: communications (the "Permitted Purpose") service. This Agreement does not apply to Licensee wireless communications equipment.

In the event Licensee intends to expand or modify its Permitted Purpose, Licensee shall provide at least ninety (90) days advance written notice to PacifiCorp. Following receipt of such notice, PacifiCorp shall determine in its sole discretion, whether to permit the modification or expansion and if permitted, whether this Agreement shall be amended accordingly or whether Licensee shall be required to enter into a new agreement.

Section 2.03 Reservation of Rights

PacifiCorp reserves the right, in its sole judgment, to reject applications for Attachment to its Poles for the following reasons:

- a. Insufficient capacity - once all reasonable potential accommodations have been considered by PacifiCorp and communicated to Licensee.
- b. Necessary for PacifiCorp's own sole use or would threaten PacifiCorp's system reliability.
- c. Proposed Licensee Attachment is considered to be unsafe according to the NESC, PacifiCorp's Distribution Construction Standards (Exhibit C) or Commission safety rules.
- d. Unreasonable interference with PacifiCorp or a third party's Equipment.
- e. Licensee's account with PacifiCorp is not in good standing.
- f. If licensee is in default of this Agreement.

ARTICLE III. LICENSEE'S USE OF POLES

Section 3.01 Application for Permission to Install Attachment

With the exception of service drops, as addressed in Section 3.02, Licensee shall not have the right to place, nor shall it place, any Equipment upon Poles without first making application and receiving permission to do so; nor shall Licensee modify the position of any Attachment upon any Poles without first making application and receiving permission to do so.

Licensee shall apply for prior permission from PacifiCorp to place any Equipment upon any Poles, or overlash its Equipment to any existing Attachments or other Equipment already attached to Poles, in writing or via the Electronic Notification System (ENS). The application shall include, without

limitation: all location information with PacifiCorp's Pole numbers; Equipment to be attached; engineering information for the calculation of Pole loading, clearances and viability of each Pole; indication of required Make-ready Work as outlined in Section 3.02; and all applicable contact information for the Licensee or Licensee's qualified contractor. PacifiCorp will either approve or deny applications in writing within forty-five (45) days of receipt of the application.

Licensee shall promptly submit payment for all fees applicable to the assessment of proposed Attachments pursuant to the Fee Schedule (Exhibit B) upon receipt of an invoice from PacifiCorp. Rental charges for each approved Attachment shall commence as of the date of PacifiCorp's approval of the application pursuant to the Rental Rate Schedule (Exhibit A) and the first charge for annual rent on the Attachment shall be charged at this time, with no abatement for the period of the current annual billing period prior to the Attachment approval. For illustrative purposes only, if the Attachment is approved in December and the current annual billing period is the prior July through the following June, for \$100 per Attachment, the Licensee will be charged \$100 in December for the new approved attachment and then \$100 for the Attachment the following July for the next annual billing period.

Section 3.02 Make-ready Work

If in the reasonable judgment of PacifiCorp the accommodation of any of Licensee's Attachments necessitates Make-ready Work, in the response to Licensee's application PacifiCorp will indicate the Make-ready Work that will be necessary to accommodate the Attachments requested and the estimated cost thereof within the application processing time period identified in Section 3.02. If Licensee is willing to bear the cost of all Make-ready Work necessary, as determined by PacifiCorp, Licensee shall so indicate by submitting a check in accordance with UAR 746-345-3.C.7 and notifying the PacifiCorp via ENS (if applicable) or in writing within thirty (30) days of the date of PacifiCorp's response to Licensee's initial application. PacifiCorp will provide Licensee an estimated completion date for any Make-ready Work, taking into account the timeframes set by R746-345-3, the overall scope of the Licensee's project, the volume of applications received from other licensees, as well as the availability of crews to perform the work. The Licensee and the PacifiCorp shall negotiate solutions in good faith when the estimated time to perform the Make-ready Work does not meet the Licensee's project requirements. At Licensee's option and upon approval from PacifiCorp, Licensee may request either assistance with the work by Licensee or by qualified contractors hired by the Licensee, payment of premium rates for PacifiCorp's employees to be dedicated to perform work solely on Licensee's project, or similar measures designed to augment the PacifiCorp's capabilities. If Licensee chooses to employ a qualified contractor to complete the Make-ready Work, to ensure safety and reliability, the contractor and the schedule must be approved by PacifiCorp.

PacifiCorp will perform such Make-ready Work as may be required and Licensee will pay the PacifiCorp for the Make-ready Work in accordance with the procedures outlined in R746-345-3. Licensee shall pay the costs of all Make-ready Work undertaken by PacifiCorp where such work is initiated as a result of the proposed installation of Attachments on any poles without regard to whether Licensee elects not to use the pole or poles after Make-ready Work has commenced. Upon request PacifiCorp shall provide Licensee, a statement detailing the actual material, hours, equipment costs, and any other associated costs will be provided to Licensee for payment of Make-ready Work.

Section 3.03 Licensee's Installation Responsibilities

Licensee shall complete the installation of its Attachments upon the Pole(s) covered by each approved application within one hundred eighty (180) days following approval by PacifiCorp. Licensee shall

provide written notice to PacifiCorp of its completion within five (5) business days of the actual installation.

If the Licensee requires a more than one hundred (180) days following PacifiCorp's approval of its Application to install its equipment, the Licensee shall notify PacifiCorp in writing, within the required one hundred eighty (180) day time limit, of its request for an extended period to install its Attachment. PacifiCorp and Licensee shall discuss the additional time requested to complete the Attachment, and PacifiCorp, in its reasonable discretion, may grant Licensee an agreed upon additional time to complete the Attachment.

In the event Licensee fails to complete installation of its Attachments within the prescribed time limit, the permission granted by PacifiCorp to place Attachments upon the Pole or Poles shall automatically terminate and Licensee shall be required to reapply and receive permission to do so, all as prescribed in Section 3.01, as applicable to the initial application. Licensee's failure to actually install its Equipment, after it has received approval from PacifiCorp, shall not constitute entitlement for any refund or reduction of fees or rental charges incurred for its proposed attachments.

Licensee shall have the right to install service drops prior to, but still subject to, approval by PacifiCorp. However, when Licensee installs service drops, Licensee must follow all procedures applicable to Attachments generally, except that the application pertaining to the service drop must be submitted to PacifiCorp no later than five (5) Business Days after installation. Should PacifiCorp deny permission to install the service drop, Licensee shall remove the service drop immediately.

If Licensee has not removed its Attachments or fails to contact PacifiCorp requesting a reasonable extension within the five (5) Business Day period, or in the case of emergencies, within the period specified by PacifiCorp, PacifiCorp may remove Licensee's Equipment at Licensee's sole risk and expense, and Licensee shall pay, upon demand, for all costs thereby incurred by PacifiCorp.

Section 3.04 Identification of Equipment

Licensee shall clearly mark each Attachment with suitable identification as determined in advance by PacifiCorp. Licensee's identification must be visible from the ground and not interfere with other facility identification.

Section 3.05 Conformance to Requirements and Specifications

Licensee shall, at its sole risk and expense, place and maintain its Equipment upon the Poles in conformity with the requirements and specifications of the NESC and such requirements and specifications as PacifiCorp shall from time to time prescribe, including without limitation, the current PacifiCorp Distribution Construction Standards (Exhibit C). In the event of any conflict between any of the requirements and specifications of the NESC, of the Commission, and those prescribed by PacifiCorp, the more stringent requirements and specifications shall govern. In the event there are changes in any such requirements or specifications, including but not limited to changes in required clearances, Licensee shall modify its Equipment to comply with such changes at its sole risk and expense.

Licensee (including its employees and contractors) shall not enter PacifiCorp's electric utility space for any purpose including making connections to the PacifiCorp neutral. If Licensee requires grounding on an existing Pole where a grounding conductor does not exist, Licensee shall request that PacifiCorp

install grounding at the sole expense of Licensee. Licensee, its employees and its contractors, shall at all times exercise Licensee's rights and perform Licensee's responsibilities under the terms of this Agreement in a manner that treats all electric facilities of PacifiCorp as energized at all times.

Licensee shall have in place a facility inspection program that ensures compliance with the requirements and specifications of this section, and Licensee shall provide PacifiCorp with comprehensive documentation of Licensee's program upon request.

Section 3.06 Nonconforming Equipment

If any Attachment is not placed and maintained in accordance with the requirements and specifications of Section 3.04 PacifiCorp reserves the right to correct said condition upon Licensee's failure to do so.

Such work shall be performed at Licensee's sole risk and expense. PacifiCorp will attempt to notify Licensee in writing prior to performing such work, whenever practicable. However, if PacifiCorp determines the conditions pose an immediate threat to the safety of utility workers or the public, interfere with the performance of PacifiCorp's service obligations, or pose an immediate threat to the integrity of PacifiCorp's Poles or Equipment, PacifiCorp may perform such work, without prior notice, at the sole risk and expense of the Licensee. As soon as practicable thereafter, PacifiCorp will notify Licensee in writing of the work performed. Licensee shall pay, upon demand, all costs thereby incurred by PacifiCorp including any applied sanctions.

Section 3.07 Interference with PacifiCorp's Equipment

If, in PacifiCorp's judgment, Licensee's existing Attachments on any Pole interfere with PacifiCorp's existing Equipment or prevent the placing of any additional Equipment by PacifiCorp, PacifiCorp will notify Licensee in writing of rearrangements or transfers of Licensee's Equipment, Pole replacements or other changes required in order to continue to accommodate Licensee's Attachments. If appropriate, this notice will include an estimate of any applicable cost for PacifiCorp to complete work to accommodate Licensee's continued attachment.

If Licensee desires to continue to maintain its Attachments on a Pole where an estimate has been provided for accommodation work to be completed by PacifiCorp, it will return PacifiCorp's notice of the estimated cost, signed by an authorized Licensee representative, within thirty (30) days. If Licensee does not accept the cost to accommodate its continued attachment, Licensee shall remove its Attachments from the affected Pole or Poles within thirty (30) days from such notification by PacifiCorp; provided, however, that PacifiCorp in any emergency may require Licensee to remove its Attachments within the time required by the emergency. Licensee shall notify PacifiCorp of its removal within five (5) Business Days of completion of the removal.

If Licensee has not removed its Attachments at the end of the thirty (30) day period, or in the case of emergencies, within the period specified by PacifiCorp, PacifiCorp may remove Licensee's Equipment at Licensee's sole risk and expense, and Licensee shall pay, upon demand, for all costs thereby incurred by PacifiCorp.

Section 3.08 Pole Replacement for Licensee's Benefit

Where an existing Pole is prematurely replaced by a new Pole for the benefit of the Licensee, the Licensee shall reimburse PacifiCorp for all costs, including, but not limited to, the cost to replace the Pole, transfer of existing PacifiCorp equipment, lower and haul of the existing Pole, and topping of the

existing Pole when performed either as an accommodation to Licensee or as required by NESC. PacifiCorp shall remove and may retain or dispose of such Pole as the sole owner thereof. Any payments for Poles made by the Licensee shall not entitle Licensee to ownership of any part of said Poles.

Section 3.09 Expense of Situating Pole Attachments

Licensee shall place, maintain, rearrange, transfer, and remove its own Attachments at its own expense except as otherwise expressly provided hereunder.

Section 3.10 Mid-span Poles

Any Poles erected by Licensee shall not interfere with, or be in-line with PacifiCorp's Poles, and shall not create a structure conflict as defined in the NESC. If Licensee requires placement of a Pole in-line with any existing Poles ("i.e., a mid-span Pole"), Licensee shall notify PacifiCorp of its need and PacifiCorp shall determine whether it wishes to place Pole facilities in such location. Licensee shall pay, upon demand, PacifiCorp for all costs incurred by PacifiCorp in installing such additional Poles. PacifiCorp will have sole ownership of the mid-span Pole and Licensee will pay rental fees to PacifiCorp in accordance with Article IV.

Section 3.11 Vegetation Management

All vegetation management in connection with the initial placement of wires or other Equipment shall be undertaken entirely by the party placing the wires or other Equipment at such party's sole risk and expense. Unless agreed to otherwise, each Party shall be responsible for any and all vegetation management related to the wires or Equipment it owns. If Licensee fails to fulfill its obligations of this section, PacifiCorp shall provide written notice to Licensee that if the issue is not resolved within thirty (30) days, PacifiCorp will perform the required remedy at Licensee's sole risk and expense.

Section 3.12 Third-party Consents, Permits, Licenses, or Grants

Licensee shall be solely responsible for obtaining from public authorities and private owners of real property and maintaining in effect any and all consents, permits, licenses or grants necessary for the lawful exercise by Licensee of the permission granted by PacifiCorp hereunder. PacifiCorp, at any time, may require Licensee to submit written documentation of compliance with this Section. Upon notice from PacifiCorp to Licensee that necessary permission for the use of any Pole or Poles has expired, or has not been secured from property owners or public authorities, any permission granted covering the use of such Pole or Poles shall immediately terminate and Licensee shall remove its Equipment from the affected Pole or Poles within thirty (30) days of said notice, or within the period required by the property owners or public authorities, whichever is shorter. If Licensee has not removed its Equipment within said period, PacifiCorp may remove Licensee's Equipment from such Poles without incurring any liability and Licensee shall, upon demand, pay PacifiCorp all costs incurred by PacifiCorp in the removal of Licensee's Equipment.

Section 3.13 Relocation of Attachments at PacifiCorp's Option

Licensee shall at any time at its own sole risk and expense, upon notice from PacifiCorp, relocate, replace, repair, or perform any other work in connection with the Attachments that may be required by PacifiCorp, within thirty (30) days unless another timeframe is specified in writing by PacifiCorp. Licensee shall provide written notification to PacifiCorp within five (5) Business Days of its completion. Provided, however, that in cases of emergency or if Licensee does not complete required work at the end of the thirty (30) day period, PacifiCorp may complete any work in connection with

the Licensee's Attachments that may be required, and Licensee will, upon demand, reimburse PacifiCorp for the entire expense thereby incurred.

Where PacifiCorp replaces its Pole and cannot remove the replaced Pole due to Licensee's Attachment, PacifiCorp shall remove the top of the Pole to allow the Licensee to relocate its Attachment to the new Pole and make a return trip to remove the replaced Pole. Licensee shall reimburse PacifiCorp for the cost incurred for the topping and return trip.

Section 3.14 Removal of Attachments by Licensee

Licensee may at any time remove its Attachments from any of the Poles and, in each case, Licensee shall immediately give PacifiCorp written notice of such removal. Application and Inspection fees will apply to notices to remove attachments pursuant to the Fee Schedule (Exhibit B). Removal of the Attachments from any Pole shall constitute a termination of Licensee's right to use such Pole. Licensee shall not be entitled to a refund of any rental on account of any such removal. When Licensee removes Attachments, the applicable Attachment count will be reduced in the next annual billing cycle following Licensee's proper notice to PacifiCorp of the removal. When Licensee performs maintenance to or removes or replaces its Equipment on a PacifiCorp Pole, Licensee shall chemically treat all field drilled holes and plug any unused holes, including those resulting from removal of Equipment; if Licensee fails to adequately plug and treat such holes, PacifiCorp may do so at Licensee's sole risk and expense.

Section 3.15 Damage to Equipment

Licensee shall exercise all necessary precautions to avoid causing damage to PacifiCorp's Poles and Equipment and other Pole users' Equipment; Licensee shall assume responsibility for any and all loss from any such damage and shall reimburse the PacifiCorp of the damaged Poles or Equipment for the entire expense incurred in making repairs.

Section 3.16 Inspections and Audits

Inspections. PacifiCorp shall have the right to perform an Inspection of each of Licensee's Attachments and other Equipment upon and in the vicinity of PacifiCorp Poles at any time. Except for routine periodic inspections, PacifiCorp may charge Licensee for the expense of any such Inspections, including Inspections for Make-ready Work, pre-construction Inspections, Inspections during installation of Licensee's equipment, post-construction (including any modifications or Pole transfers) Inspections, and any other Inspections requested by the Licensee or deemed necessary by PacifiCorp. The frequency of periodic Inspections will be determined in PacifiCorp's reasonable discretion,

Audits. PacifiCorp may conduct an Audit of Attachments made to its Poles no more frequently than once every five (5) years. PacifiCorp shall give Licensee at least ninety (90) days prior notice of an initial meeting to plan the next Audit. At such meeting, PacifiCorp, Licensee and all other Pole attachers in attendance in person or by representative shall participate in, among other things, review of the predicted costs to perform an audit, the selection of an independent contractor for conducting the Audit, as well as the scheduling, scope, extent and reporting of the Audit results. Regardless of whether Licensee attends the Audit planning meeting or expresses an intention to participate in the Audit, PacifiCorp shall notify Licensee at least sixty (60) days prior to the commencement of the Audit. Licensee shall advise PacifiCorp if Licensee desires to participate in the Audit with PacifiCorp not less than thirty (30) days prior to the scheduled date of such Audit. The cost of the Audit shall be included in the rental rate pursuant to the methodology approved by the Commission for such

purposes. The data from the Audit shall be made available to Licensee and all other attachers on the Poles and used to update the Parties' records. Any Party shall make any objections to the Audit results within ninety (90) days of receipt of the Audit report or such objections are waived.

Section 3.17 Tax Liability

Licensee shall promptly pay any tax, fee, or charge that may be levied or assessed against PacifiCorp's Poles or property resulting from use by Licensee. If Licensee should fail to pay any such tax or assessment on or before the date such tax or assessment becomes delinquent, PacifiCorp, at its own option, may pay such tax on account of Licensee and Licensee shall, upon demand, reimburse PacifiCorp for the full amount of tax and any penalties so paid.

ARTICLE IV. RENTAL PAYMENTS

Section 4.01 Rental Amount

For authorized Attachments covered under this Agreement, Licensee shall pay to PacifiCorp, in advance, on an annual basis, a rental amount computed in accordance with UAR R746-345-5.A. as set forth in Exhibit A, on a billing cycle beginning July 1 of each year. The rental amount for each year shall be based on PacifiCorp's tabulation of Licensee's Attachments situated upon PacifiCorp's Poles and based upon PacifiCorp's current records.

Consistent with the terms of this provision, the components of the rental rates, and the methodology employed to determine the rental rates are subject to UAR R746-345-5.A and may not be changed, modified or replaced except as allowed by and in accordance with UAR R746-345-3.A.1., and as otherwise approved by the Commission. Parties recognize that rates may change consistent with the methodology, but such changes will be pre-approved by the Commission.

Section 4.02 Unauthorized Attachments

Licensee shall not make Attachments to PacifiCorp's Poles without obtaining the PacifiCorp's written permission as provided for in this Agreement. PacifiCorp may charge Licensee the amounts contained in the Fee Schedule attached hereto as Exhibit B upon the discovery of unauthorized Attachment, on each Pole, belonging to Licensee. The imposition of such charges shall be without prejudice to PacifiCorp's right to utilize additional other remedies, including, but not limited to, the remedies available for default under Article VI of this Agreement and any remedies available under Commission rules. The Licensee may avoid unauthorized attachment fees, except back rent, if it self-discloses unpermitted attachments and provides an application for said attachment permits prior to PacifiCorp's discovery.

Section 4.03 Billing and Payments

PacifiCorp shall send invoices to Licensee via regular U.S. Mail at the address specified below, or at such other address as Licensee may designate from time to time in writing. Licensee shall pay all charges within forty-five (45) days of the invoice date. Late charges and interest shall be imposed on any delinquent amounts as specified in Section 4.04.

In the event Licensee disputes an invoice, Licensee shall provide written notice of the dispute to PacifiCorp within sixty (60) days of the date of the disputed invoice, otherwise Licensee shall forfeit its right to dispute the invoice. Notice shall include an explanation of the Licensee's dispute.

PacifiCorp reserves the right to impose late fees and/or interest as specified in Section 4.05 in the event the dispute is unfounded.

Licensee's billing address:

CentraCom Interactive DBA
P.O. Box 7
35 South State
Fairview UT 84629
Attn: Monte Christensen

Section 4.04 Interest on Late Payments

All amounts payable under the provisions of this Agreement shall, unless otherwise specified, be payable within forty-five (45) days of the invoice date. An interest charge at the maximum rate allowed by applicable law shall be assessed against all late payments.

Section 4.05 Adequate Assurances

PacifiCorp shall have the right to request adequate assurances from Licensee, including, but not limited to, the posting of security, in a form reasonably satisfactory to PacifiCorp in the event, the credit rating of Licensee falls below the rating level of CCC. Licensee shall provide adequate assurances in a form acceptable to PacifiCorp within ten (10) Business Days following demand thereof.

ARTICLE V. INDEMNIFICATION; LIMITATIONS OF LIABILITY; WARRANTIES

Section 5.01 Indemnification/Release

To the fullest extent permitted by law, Licensee shall indemnify, protect, and hold harmless PacifiCorp and its directors, officers, employees and agents (collectively, the "PacifiCorp Indemnified Parties") against and from any and all claims, demands, suits, losses, costs and damages of every kind and description, including attorneys' fees and/or litigation expenses, brought or made against or incurred by the PacifiCorp Indemnified Parties resulting from, arising out of, or in any way connected with any act, omission, fault or negligence of Licensee, its employees, agents, representatives or contractors, their employees, agents or representatives in the performance or nonperformance of Licensee's obligations under this Agreement or in any way related to this Agreement except to the extent that such claim, demand, loss, cause of action, or costs arises from PacifiCorp's negligence or willful misconduct. Licensee shall also indemnify and release, protect and hold harmless the PacifiCorp Indemnified Parties from and against any and all claims, demands, causes of action, costs (including attorneys' fees), or other liabilities arising from any interruption, discontinuance, or interference with Licensee's service to its customers which may be caused, or which may be claimed to have been caused, by any action of PacifiCorp undertaken in furtherance of the purposes of this Agreement. In addition, Licensee shall, upon demand, and at its own sole risk and expense, defend any and all suits, actions, or other legal proceedings which may be brought against PacifiCorp, or its successors or assigns, on any claim, demand, or cause of action arising from any interruption, discontinuance, or interference with PacifiCorp's service to PacifiCorp's customers which may be caused, or which may be claimed to have been caused, by any action of Licensee. Provided PacifiCorp has tendered defense to Licensee, Licensee shall pay and satisfy any judgment or decree which may be rendered against PacifiCorp, or its successors or assigns, in any such suit, action, or other legal proceeding; and further,

Licensee shall reimburse PacifiCorp for any and all legal expenses, including attorneys' fees, incurred in connection therewith, including appeals thereof. Licensee hereby releases PacifiCorp from any liability for damage to Equipment, or for any interruption, discontinuance or interference with Licensee's service to its customers, caused by or resulting from such removal, including damages caused by PacifiCorp's ordinary negligence.

Section 5.02 Warranty

PacifiCorp warrants that its work in constructing and maintaining the Poles covered by this Agreement shall be consistent with prudent utility practices. **PACIFICORP DISCLAIMS ALL OTHER WARRANTIES, EXPRESS OR IMPLIED, INCLUDING BUT NOT LIMITED TO THE WARRANTY OF MERCHANTABILITY, FITNESS FOR PARTICULAR PURPOSE, AND SIMILAR WARRANTIES.** Under no circumstances shall either Party be liable for economic losses, costs or damages, including but not limited to special, indirect, incidental, punitive, exemplary or consequential damages.

ARTICLE VI. INSURANCE AND BOND

Section 6.01 Insurance

Without limiting any liabilities or any other obligations of Licensee, Licensee shall secure and continuously carry during the term of this Agreement with insurers having an A.M. Best Insurance Reports rating of A-:VII or better the following insurance coverage:

- a. Workers' Compensation. Licensee shall comply with all applicable Workers' Compensation Laws and shall furnish proof thereof satisfactory to Rocky Mountain Power prior to commencing Work.

All Workers' Compensation policies shall contain provisions that the insurance companies will have no right of recovery or subrogation against Rocky Mountain Power, its parent, divisions, affiliates, subsidiary companies, co-lessees, or co-venturers, agents, directors, officers, employees, servants, and insurers, it being the intention of the Parties that the insurance as effected shall protect all parties.

- b. Employers' Liability. Insurance with a minimum single limit of \$1,000,000 each accident, \$1,000,000 by disease-each employee, and \$1,000,000 by disease-policy limit.
- c. Commercial General Liability. Licensee shall maintain commercial general liability insurance on the most recently approved ISO policy, or its equivalent, written on an occurrence basis, with minimum limits of \$1,000,000 each occurrence/ \$2,000,000 general aggregate for bodily injury and property damage, including the following coverages:
 - a. Premises and operations coverage
 - b. Independent contractor's coverage
 - c. Contractual liability
 - d. Broad form property damage liability
 - e. Sudden and accidental pollution liability, if appropriate
- d. Business Automobile Liability. Licensee shall maintain business automobile liability insurance on the most recently approved ISO policy, or its equivalent, with a minimum combined single limit

of \$1,000,000 for bodily injury and property damage with respect to Licensee's vehicles whether owned, hired or non-owned, assigned to or used in the performance of the Work.

- e. **Umbrella Liability.** Licensee shall maintain umbrella or excess liability insurance with minimum limits of \$5,000,000 each occurrence/\$5,000,000 aggregate where applicable, providing following form coverage in excess of the coverages and limits required in Employers' Liability insurance, Commercial General Liability insurance and Business Automobile Liability insurance above. Licensee shall notify Rocky Mountain Power, if at any time their full umbrella limit is not available during the term of this Agreement, and will purchase additional limits, if requested by Rocky Mountain Power.

Section 6.02 Additional Insurance Requirements

The following additional requirements apply to coverage specified in Section 6.01:

Commercial general liability and business automobile insurance policies shall include provisions or endorsements that:

- i) name Rocky Mountain Power, its officers, directors, agents, and employees as additional insureds.
- ii) such insurance is primary insurance with respect to the interests of Rocky Mountain Power and that any other insurance maintained by Rocky Mountain Power is excess and not contributory insurance with the insurance required herein;
- iii) such insurance shall provide cross liability or a severability of interest clause.

All policies shall include provisions or endorsements that provide:

- i) limits of coverage in each of these required policies shall not be reduced without written notification to Rocky Mountain Power prior to the effective date of such change, and
- ii) no policy shall be cancelled without prior written notice to Rocky Mountain Power and to all other insured parties of no less than (a) ten (10) days if cancelled for nonpayment of premium, or (b) thirty (30) days if cancelled for any other reason.

All required insurance policies shall not contain any provisions prohibiting waivers of subrogation. Unless prohibited by applicable law, all required insurance policies shall contain provisions that the insurer will have no right of recovery or subrogation against Rocky Mountain Power, its parent, divisions, affiliates, subsidiary companies, co-lessees, or co-venturers, agents directors, officers, employees, servants, and insurers, it being the intention of the Parties that the insurance as effected shall protect all parties.

Prior to installation of equipment as permitted under this Agreement, and prior to expiration of each policy throughout the term of this Agreement, Licensee shall provide certificates of insurance evidencing current insurance coverage, and confirming compliance with the requirements stated in this article.

Section 6.03 Bonding

PacifiCorp may require Licensee to furnish a bond to cover the faithful performance by Licensee of its obligations hereunder. Any such bond shall be issued by a commercial bonding company selected by Licensee and satisfactory to PacifiCorp; shall not be subject to termination or cancellation except upon one hundred twenty (120) days prior notice to PacifiCorp; shall be in such form and in such amount as PacifiCorp shall specify from time to time; and, subject to termination or cancellation as aforesaid,

shall be maintained in full force and effect throughout the term of this Agreement, including any renewals thereof. Such bond shall be furnished within ninety (90) days written notice to Licensee by PacifiCorp. The furnishing of a bond shall not relieve Licensee of any of its obligations under this Agreement, and the bond shall not be released until all of Licensee's obligations under this Agreement have been discharged.

ARTICLE VII. TERM, DEFAULT AND TERMINATION

Section 7.01 Term and Termination

Unless terminated sooner as provided herein, this Agreement shall remain in full force and effect unless and until it is terminated by either Party upon ninety (90) days written notice to the other Party. Licensee shall remove its Equipment from Poles within said ninety (90) day notice period. Should Licensee fail to remove its Equipment within such period, PacifiCorp may remove and dispose of Licensee's Equipment at Licensee's sole risk and expense. On the date of termination specified in such notice, all rights and privileges of Licensee hereunder shall cease; provided however that Licensee shall not be released from any liability hereunder, which may accrue or be accruing or which arises out of any claim that may have accrued or may be accruing at the time of termination.

PacifiCorp reserves the right to terminate Licensee's permit to use any particular Pole or Poles at any time upon thirty (30) days written notice to Licensee and Licensee shall remove its Equipment from PacifiCorp's Pole or Poles within the thirty (30) day period and provide written notice to PacifiCorp upon its completion.

Section 7.02 Default

The following shall constitute a default hereunder if not cured within thirty (30) days following notice: (a) any material breach of this Agreement; (b) the appointment of a receiver to take possession of all of the assets of Licensee; (c) a general assignment for benefit of creditors; (d) any action taken or suffered by Licensee under any insolvency or bankruptcy act.

Section 7.03 Notice of Default/Cure Period

The non-defaulting Party shall provide written notice of the default to the other and the defaulting Party shall have thirty (30) days from receipt of said notice to cure the default.

Section 7.04 Remedies for Default

PacifiCorp may utilize any and all remedies available to it at law and in equity in the event Licensee fails to cure a default within the time period set forth above. Such remedies may include, without limitation: (a) refusal to authorize any additional Attachments until the default is cured; (b) termination, in whole or in part, of this Agreement; (c) withhold amounts due to Licensee from PacifiCorp pursuant to this Agreement or another agreement; (d) cure the default at Licensee's sole cost and expense.

ARTICLE VIII. GENERAL PROVISIONS

Section 8.01 Confidentiality

Additionally, each of the Parties agrees to keep strictly confidential the terms of this Agreement, and not to disclose the same except: (a) to its employees, agents and representatives to the extent necessary

to perform its obligations hereunder, (b) to the extent required by law or the rules of any regulatory agency, or (c) if compelled by order of any court or governmental agency of competent jurisdiction, provided that with respect to (b) and (c) above, the disclosing Party shall give the non-disclosing Party prompt prior written notice of any disclosure request, application for court order, court order or other governmental process, before making any disclosure and shall give the non-disclosing Party an opportunity to object to and seek to prevent or omit such disclosure.

Section 8.02 Entire Agreement

This Agreement constitutes the entire Agreement of the Parties and supersedes and terminates any prior agreements. Any amendments hereto shall be in writing.

Section 8.03 Choice of Law/Venue

This Agreement and performance hereunder shall be construed, interpreted, regulated and enforced pursuant to the laws of Utah. The state and federal courts within Utah shall constitute the sole proper venue for resolution hereunder and the Parties agree to submit to such jurisdiction.

Section 8.04 Changes in Law

The Parties agree to negotiate in good faith any changes to this Agreement necessitated to conform to applicable law.

Section 8.05 Severability

If any provision or part of this Agreement is or becomes invalid under any applicable statute, regulation, or law and such invalidity does not materially alter the essence of this Agreement with respect to either Party, the invalidity shall not render this entire Agreement unenforceable and such provision or part shall be deemed void.

Section 8.06 Encumbrances

Licensee shall prevent any and all liens or other encumbrances from attaching, as result of Licensee's activities hereunder, to PacifiCorp's property.

Section 8.07 Headings and Exhibits

The captions and headings herein are for convenience in reference only and not for interpretation purposes. All exhibits referred to herein and recitals are incorporated by reference.

Section 8.08 Force Majeure

Except for the payment of monies due under this Agreement, neither Party shall be deemed in default hereunder to the extent that any delay or failure in the performance of its obligations hereunder is caused by an event of Force Majeure, including acts of the United States of America or any state, territory or political subdivision thereof, acts of God or a public enemy, fire, flood, freight embargos, civil disturbances or any other cause beyond the reasonable control of the Party claiming Force Majeure. The Party claiming Force Majeure shall provide prompt written notice to the other Party and shall immediately commence default and so notify the other Party once it is reasonably practicable to do so.

Section 8.09 Assignments

Licensee may assign or transfer this Agreement to a controlling or controlled affiliate or to a successor in the event of reorganization, including a merger or sale of substantially all of its assets, without the consent of PacifiCorp; provided, however, that Licensee first notifies PacifiCorp of such assignment or

transfer in writing and assignee assumes all obligations and liabilities of Licensee hereunder and takes reasonable measures to cooperate with PacifiCorp to update PacifiCorp's records regarding the proper attaching entity. Any Assignment made in violation of this section 8.09 shall be void.

Section 8.10 Waiver

Failure by either Party to enforce any of the terms or provisions of this Agreement shall not be construed as a waiver hereunder.

Section 8.11 Time is of Essence

Time is of essence with respect to every term and provision of this Agreement.

Section 8.12 No Partnership

Nothing herein shall be construed to create a partnership, trust, joint venture, or association between the Parties.

Section 8.13 No Third Party Beneficiaries

This Agreement shall not be construed for the benefit of any third party, including without limitation, customers of either Party.

Section 8.14 Attorneys' Fees

If either Party files any action or brings any proceeding against the other arising from or related to this Agreement, the prevailing Party shall be entitled to recover, in addition to any judgment or decree for costs, such reasonable attorneys' fees as it may have incurred in such suit, action, or other legal proceeding, together with other reasonable litigation expenses.

Section 8.15 Notices

Except as otherwise provided herein for use of PacifiCorp's designated ENS, both parties will provide notice to each other in writing and shall be considered given if personally delivered, transmitted by facsimile, sent via overnight delivery, or via US Mail, shall be addressed to the Party to be notified at the addresses set forth below or at such other address as a Party may designate for itself from time to time by notice:

If to Licensor:

PacifiCorp
825 NE Multnomah St., Suite 1700
Portland, OR 97232
Attn: Joint Use Administration

FAX: 503-813-6005


If to Licensee:


CentraCom Interactive DBA
P.O. Box 7
35 South State
Fairview UT 84629
Attn: Pam Rigby

IN WITNESS WHEREOF, the Parties have caused this Agreement to be executed by their duly authorized officers as of the date first herein written.

LICENSEE
CENTRACOM INTERACTIVE DBA

PACIFICORP, doing business as
PACIFIC POWER and
ROCKY MOUNTAIN POWER


Signed
EDDIE L. COX
Printed
PRESIDENT
Title
7-14-10
Date Signed


Signed
William EAquinto
Printed
VP. T&D Operations
Title
8/9/10
Date Signed



P.S.C.U. No. 47

Original Sheet No. 4.1

ROCKY MOUNTAIN POWER
ELECTRIC SERVICE SCHEDULE NO. 4

STATE OF UTAH

Pole Attachments

AVAILABILITY: To public utilities, wireless providers, cable television companies, communications companies, or other entities that provide information or telecommunications services or any other services whose operation requires that cables, wires, and other appurtenances be placed on Company utility poles. This Schedule shall be available only upon the following three conditions:

1. The execution of a Pole Attachment Agreement between an "attaching entity" as defined by Utah Admin. Code § R746-345-2 and the Company for permission to place equipment on the Company's poles; or, in the event that such an agreement has not been reached, the attaching entity is subject to the provisions of the standard Attachment Agreement approved by the Utah Public Service Commission ("Standard Agreement").
2. The approval by the Company of the attaching entity's application, as required under the agreement between the Company and the attaching entity, for permission to place equipment on Company poles.
3. The availability of utility poles located on the Company's interconnected system in the state of Utah, which are of sufficient size and capacity to accommodate the equipment to be installed in accordance with the National Electric Safety Code, the applicable pole attachment agreement and applicable Utah Administrative Code provisions.

APPLICATION: The rate specified in this Electric Service Schedule shall apply to all Company-owned poles.

(continued)

Issued by authority of Report and Order of the Public Service Commission of Utah in Docket No. 06-035-21

FILED: December 7, 2006

EFFECTIVE: December 11, 2006



P.S.C.U. No. 47

Original Sheet No. 4.2

ELECTRIC SERVICE SCHEDULE NO. 4 - Continued

ANNUAL CHARGE: For each Company pole on which the attaching entity has placed an attachment, \$7.02 per foot of space used by the attaching entity. "Space used" is determined under the provisions of Utah Admin. Code § R746-345-5.A.3.

TERMS, CONDITIONS, LIABILITIES: The terms, conditions, and liabilities for service under this Schedule shall be those specified in the applicable pole attachment agreement between the Company and the attaching entity. The annual charge rate specified by the agreement shall be in accordance with the rate specified in this Schedule and shall be subject to periodic adjustment in accordance with the applicable agreement and the rules established by the Public Service Commission of Utah and subject to its approval.

ELECTRIC SERVICE REGULATIONS: Service under this Schedule will be in accordance with the terms of the Pole Attachment Agreement or the Standard Agreement between the Company and the attaching entity. The Electric Service Regulations of the Company on file with and approved by the Public Service Commission of Utah, including future applicable amendments, will be considered as forming a part of and incorporated in said Agreement. In case of any conflict between any of the provisions of the Pole Attachment Agreement or Standard Agreement, this Rate Schedule, and the Electric Service Regulations, the provisions of this Rate Schedule will take precedence followed by the provisions of the Pole Attachment Agreement or the Standard Agreement, whichever is applicable.

Issued by authority of Report and Order of the Public Service Commission of Utah in Docket No. 06-035-21

FILED: December 7, 2006

EFFECTIVE: December 11, 2006

Fee Schedule for non-recurring charges

1. Application Processing Fee (ENS or written) \$26.65 + \$4.00 per pole

Exception: PacifiCorp will invoice Licensee the actual cost associated with processing applications on Rebuild projects.

2. Inspections

In instances when PacifiCorp has sufficient electronic pole attachment data existing in its system of record, PacifiCorp may elect to perform a desktop inspection, which is defined as an inspection performed using only existing electronic data, maps and pictures. There are no inspection fees associated to a desktop inspection.

In instances when PacifiCorp does not have sufficient electronic data to perform a desktop inspection or the desktop inspection results in findings that require a field visit, the following inspection fees apply:

2(a) Pre-Inspection Fees - these fees are based upon applications by various entities that wish to attach a cable, or other device, to PacifiCorp's facilities and also occurs prior to when a Licensee wishes to place new cables and/or additional equipment. All pre and post-inspections are broken into three levels of time usage and complexity.

Level 1 (Visual Inspection) \$31.30 first pole; \$17.65 each pole thereafter

Level 1 inspections are defined as a "drive by" that does not require the inspector to exit the vehicle and are intended to identify that clearances and strength of the structure are visibly verifiable. These inspections are typically performed when the Licensee has provided all required information given the type of request on the Application form.

Level 2 (Measured Inspection) \$41.20 first pole; \$30.40 each pole thereafter

Level 2 inspections are most commonly performed when the poles do not appear to have proper clearance to accommodate the newly proposed attachment or when the Licensee has failed to provide all required information given the type of request on the Application form.

Level 3 (Pole Analysis Inspection) \$88.55 first pole; \$75.90 each pole thereafter

Level 3 inspections are most commonly performed when the poles do not appear to have proper strength to accommodate the newly proposed attachment or when the Licensee has failed to provide all required information given the type of request on the Application form. This level of inspection is highly common on requests for use of transmission poles.

PacifiCorp will not charge Pre-Inspection Fees for an application to remove attachments.

Exhibit B

Page 2 of 2

2(b) Post-Inspection Fees - these inspections are completed after a pre-inspection has been approved, and the installation by the original requesting company has been completed.

Level 4 (Visual Inspection) \$31.30 first pole; \$17.65 each pole thereafter

Level 4 inspections are defined as a "drive by" that does not require the inspector to exit the vehicle and are intended to identify that the Licensee has complied with the engineering data provided in the Application form. This level of inspection will be used for all removals of attachments, unless the removal has resulted in damage to the pole in which case additional fees to assess the damage may apply.

Level 5 (Measured Inspection) \$41.20 first pole; \$30.40 each pole thereafter

Level 5 inspections are most commonly performed when it appears that the Licensee has failed to perform construction in accordance with the specifications on their Application form, has created a NESC violation or has attached to the pole prior to receiving approval from PacifiCorp.

Level 6 (Pole Analysis Inspection) \$88.55 first pole; \$75.90 each pole thereafter

Level 6 inspections are most commonly performed when it appears that the Licensee has attached to a pole prior to receiving approval from PacifiCorp and appears to have compromised the integrity of the existing structure. This level of inspection is highly common on requests for use of transmission poles.

3. Unauthorized Attachment Charge

\$100.00 + Back Rent, per Pole

Back Rent shall consist of 5 years of rent at the current rental rate.

4. Topping Fee

A charge of \$64.00 per Pole will be assessed, where PacifiCorp completes a Pole replacement with an Attachment by the Licensee and the transfer of the Attachment requires removal of the top of the pole to be completed by PacifiCorp.

5. Return Trip Fee

A charge of \$255.00 per Pole will be assessed, where PacifiCorp completes a Pole replacement with an Attachment by the Licensee and the removal of the replaced Pole cannot be completed at the time of construction due to the Licensee's Attachment; therefore, PacifiCorp will return to the site once the Licensee transfer is complete. This charge is for the return trip, removal of the Pole is not included in this charge.

Exhibit C

Page 0 of 37 (Page 0 left blank intentionally)

PacifiCorp's Distribution Construction Standards

EU - Joint Use**Table of Contents*****Information Standards***

| <u>Standard</u> | <u>Title</u> | <u>Revision Date</u> |
|-----------------|---|----------------------|
| EU 001 | Joint Use—General Information | 10 Nov 98 |
| EU 101 | Joint Use—Pole Space Allocation | 22 Mar 07 |
| EU 211 | Joint Use—Climbing Space Through Communication Circuits | 31 May 93 |
| EU 221 | Joint Use—Clearances, Communication to Supply Circuits | 8 Nov 07 |
| EU 231 | Joint Use—Clearances, Communication Above Ground, Roadway or Water | 17 Mar 00 |
| EU 241 | Joint Use—Clearances, Communication Equipment to Risers | 17 Mar 00 |
| EU 251 | Joint Use—Clearances, Communication Equipment to Transformers | 17 Mar 00 |
| EU 261 | Joint Use—Clearances, Communication Equipment to Street Lights | 17 Mar 00 |
| EU 281 | Joint Use—Clearances, Low Voltage Service Drops | 31 May 93 |
| EU 401 | Joint Use—CATV on Poles | 22 Mar 07 |

EU

Table of Contents



Distribution Construction Standards

This page is left blank intentionally.

Joint Use—General Information

A. Scope

Joint use agreements with other utilities include standards covering the attachments involved. This section contains drawings covering joint use of poles by supply and communications circuits and equipment. These drawings conform with the applicable requirements of joint pole practices for supply and communications circuits: National Electrical Safety Code, ANSI C2-1997 (NESC); California Public Utility Commission General Order No. 95 (G.O. 95); and other state and local requirements.

B. General

The drawings in this section specify the clearances required and the typical arrangement of attachments.

Questions concerning conflicts or impaired clearances between supply circuits and communications circuits, including community antenna TV cables, which are not adequately covered by the scope or detail of this section, shall be referred to the area engineer.

These standards apply to all other utilities and other entities who own facilities which contact or are supported by equipment owned by PacifiCorp, including attachments not covered by joint use agreements.

Any trolley circuits attached to company-owned power poles will require special joint use agreements and drawings showing clearances. Trolley circuit attachments will require distribution engineering approval on a case-by-case basis.

Over-lashing of communication cables is an acceptable practice and will follow the same policy as any other attachment request. The application will be reviewed by PacifiCorp and the party being over-lashed, to determine any upgrades that may be required. The requesting party, the party that is being over-lashed, and PacifiCorp will agree to payment of the cost of any needed upgrades and the attachment fees.

The addition of the new cable will place additional loading requirements on poles and down guys and will impact the sag of the existing cable. These items will need to be reviewed to see if pole change-outs or guy replacements will be necessary.

**Distribution
Construction Standard**
© 1998 by PacifiCorp. All rights reserved.

Engineer (S. Waddoups):

Stds Team Leader (D. Jones):

Joint Use General Information

 **PACIFICORP**
PACIFIC POWER UTAH POWER

10 Nov 98

EU 001
Page 1 of 2

EU 001

This page is left blank intentionally.



PACIFICORP

PACIFIC POWER UTAH POWER

EU 001
Page 2 of 2

10 Nov 98

**Joint Use
General Information**

**Distribution
Construction Standard**

© 1998 by PacifiCorp. All rights reserved.

Engineer (S. Waddoups):

Stds Team Leader (D. Jones):

Joint Use—Pole Space Allocation

A. Scope

This standard provides information regarding the allocation of space on joint use poles for attachment of telephone, cable TV, and PacifiCorp facilities.

B. General

1. Compliance with Safety Codes and Rules

It is intended that all construction will meet or exceed the requirements of the latest edition of the National Electrical Safety Code (NESC). All work will be performed in a safe manner which complies with the rules of the NESC, the Occupational Safety and Health Administration (OSHA) and the rules of any state agencies having jurisdiction.

2. Communication Includes Telephone and Cable TV

The term "communication" is considered to include both telephone and cable TV. This is how the term is used by the NESC.

3. Available Pole Space

The setting depth of a pole in normal soil is approximately 10% of the pole length plus 2 feet. Thus a 40-foot pole will be set 6 feet into the ground with 34 feet remaining above ground; and a 45-foot pole will be set 6 1/2 feet deep with 38 1/2 feet above ground.

4. Joint Use Agreements

Some of the joint use agreements do not match all conditions set forth in the EU section of the distribution construction standards. A specific joint use agreement may spell out a different method of sharing costs of taller poles. In that case, the agreement takes precedence over this standard.

5. Bonding of Communication or Cable Equipment to Ground

When a pole ground is required by the communication utility and does not exist on the pole, the communication utility shall request the installation of a pole ground by PacifiCorp. This allows PacifiCorp to ground the neutral conductor attached to the pole. The communication company shall pay for all expenses incurred. At no time shall the communication utility personnel be in PacifiCorp's pole space.

6. Guying and Anchoring

The communication utility shall not attach their guy wires to PacifiCorp's anchors unless explicit written permission is given for each specific location. Anchor rod auxiliary eyes are not permitted on PacifiCorp anchors. Additionally, all guy wires installed on PacifiCorp anchors to support communication utility's equipment or cable shall be insulated as defined by Rule 279A2a of the NESC and in accordance with PacifiCorp standard practice. This practice meets code and also prevents galvanic corrosion of anchors. The insulator shall meet NESC flashover and strength requirements. If, by written permission, PacifiCorp allows the guy wire to be bonded at the pole, an insulator is still required that meets NESC strength requirements as stated in NESC Rules 279A3 and 279A1c.

Distribution Construction Standard

© 2007 by PacifiCorp. All rights reserved.

Engineer (D. Asgharian): *DDA*
Standards Manager (G. Lyons): *LLS*

Joint Use Pole Space Allocation



22 Mar 07

EU 101
Page 1 of 6

EU 101

All guy wires attached to the communication utility's own anchors shall meet NESC requirements.

7. Replacing an existing pole

When PacifiCorp has need to replace an existing pole with joint use attachments and the attachment cannot immediately be transferred directly to the new pole, an alternative method of attachment may be used to reduce crew and traveling time. The following criteria must be satisfied prior to such action:

1. The pole is positioned close enough to allow attachment by this method.
2. The condition of the old pole section will maintain the integrity of the attachments.
3. No other issues are apparent that sacrifice proper clearances, safety, or working conditions.

This method of attachment should be considered temporary, and affected joint use utilities must remove their facilities within a reasonable time frame. Additionally, the last joint use utility to work on the structure must remove and dispose of the old section of the pole and DA bolts.

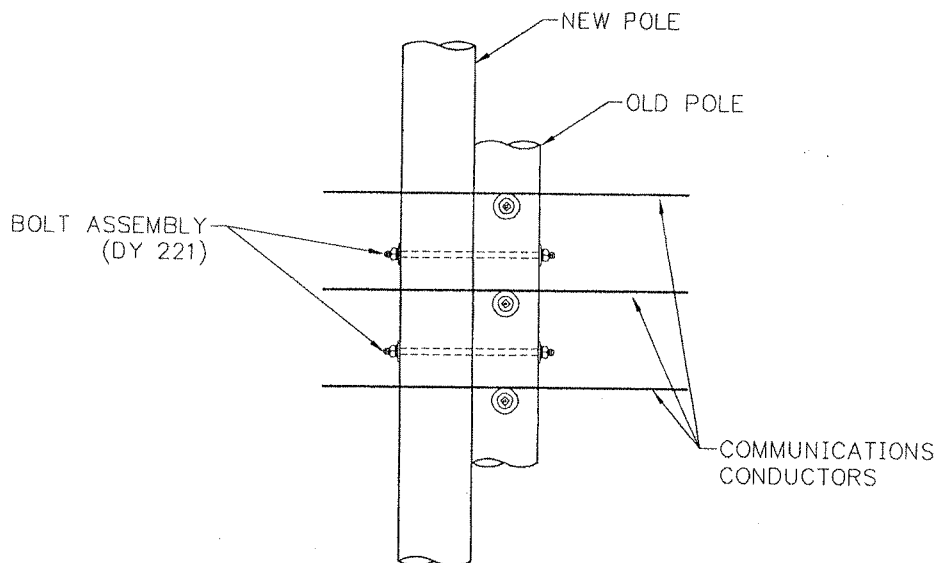


Figure 1—Pole Replacement with Existing Communications Conductors

C. Allocation of Pole Space

1. Separation Space - Permitted Uses

- a) There shall be a minimum of 40 inches of clearance between the surface (not the center) of any supply system conductors or equipment (including support hardware and washers) and any communications system conductors or equipment (including support hardware and washers).
- b) Communication equipment is not permitted to be mounted in the 40-inch separation space.



EU 101
Page 2 of 6

22 Mar 07

Joint Use Pole Space Allocation

Distribution Construction Standard

© 2007 by PacifiCorp. All rights reserved.

Engineer (D. Asgharian): *DDA*
Standards Manager (G. Lyons): *GL*

- c) Street lighting fixtures may be installed in the separation space when necessary to meet mounting height requirements provided that such installations are in accordance with the NESC and other applicable codes. For details, see EU 261. In California, see EU 271.

2. 40-Foot Basic Pole

The allocation of space and the usual points of attachments for telephone, TV cable, and electric facilities depends on the length of the "basic pole". In some areas, the basic pole is 40 feet in length (about 34 feet above ground). Figure 1 shows the space allocations and the usual points of attachment for a 40-foot joint use pole.

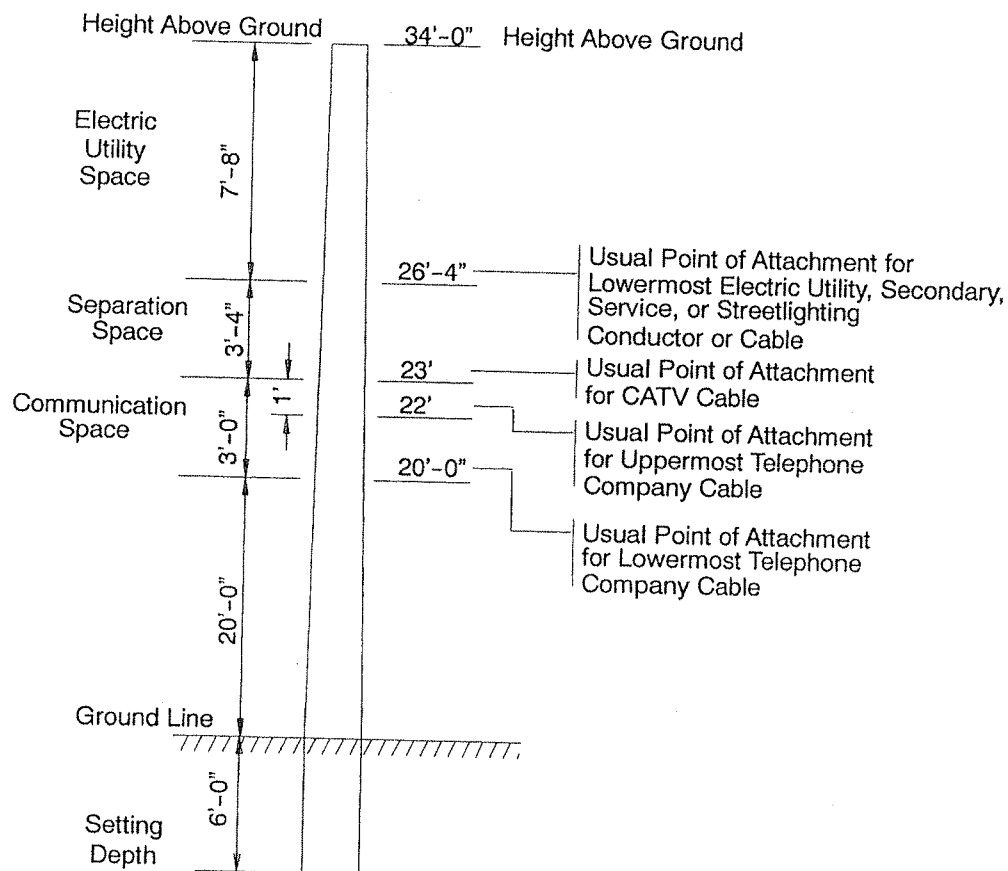


Figure 1 - Space Allocation on 40Foot Basic Joint Use Pole

Distribution Construction Standard

© 2007 by PacifiCorp. All rights reserved.

Engineer (D. Asgharian): *DDA*
Standards Manager (G. Lyons): *GL*

Joint Use Pole Space Allocation




22 Mar 07

EU 101
Page 3 of 6

3. Poles Taller Than the 40-Foot Basic Pole

The company requiring extra pole height pays the extra cost and gets to use the extra height, less the 10% used by the deeper pole hole.

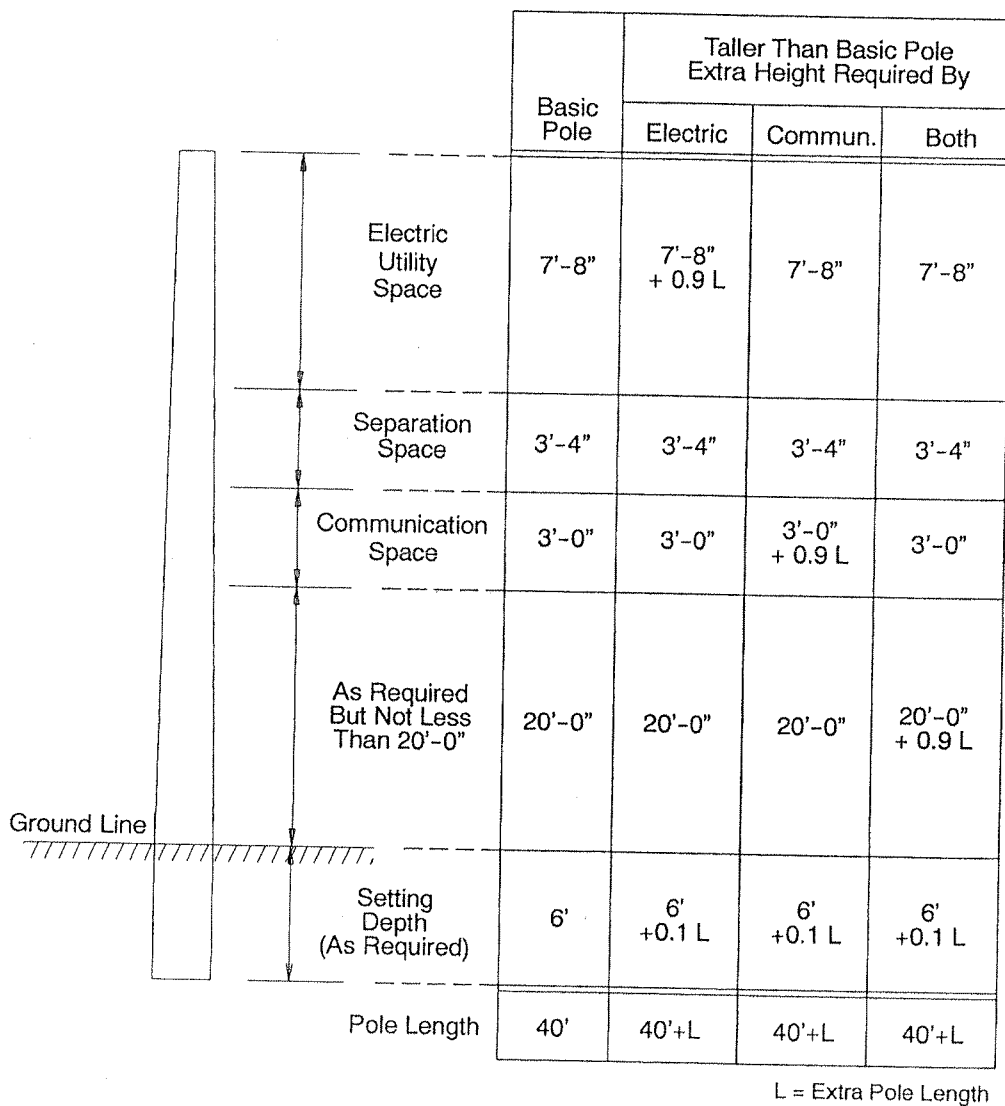

| | Basic Pole | Taller Than Basic Pole Extra Height Required By | | |
|--------------------------------------|------------|--|------------------|-------------------|
| | | Electric | Commun. | Both |
| Electric Utility Space | 7'-8" | 7'-8" + 0.9 L | 7'-8" | 7'-8" |
| Separation Space | 3'-4" | 3'-4" | 3'-4" | 3'-4" |
| Communication Space | 3'-0" | 3'-0" | 3'-0" + 0.9 L | 3'-0" |
| As Required But Not Less Than 20'-0" | 20'-0" | 20'-0" | 20'-0" | 20'-0" + 0.9 L |
| Setting Depth (As Required) | 6' | 6' +0.1 L | 6' +0.1 L | 6' +0.1 L |
| Pole Length | 40' | 40'+L | 40'+L | 40'+L |

L = Extra Pole Length

Figure 2 - Space Allocation on Poles Taller Than the 40-Foot Basic Pole

4. 45-Foot Basic Pole

The allocation of space and the usual points of attachments for telephone, TV cable, and electric facilities depends on the length of the "basic pole". In many areas, the basic pole is 45 feet in length (about 38 1/2 feet above ground). Figure 3 shows the space allocations and the usual points of attachment for a 45-foot joint use pole.

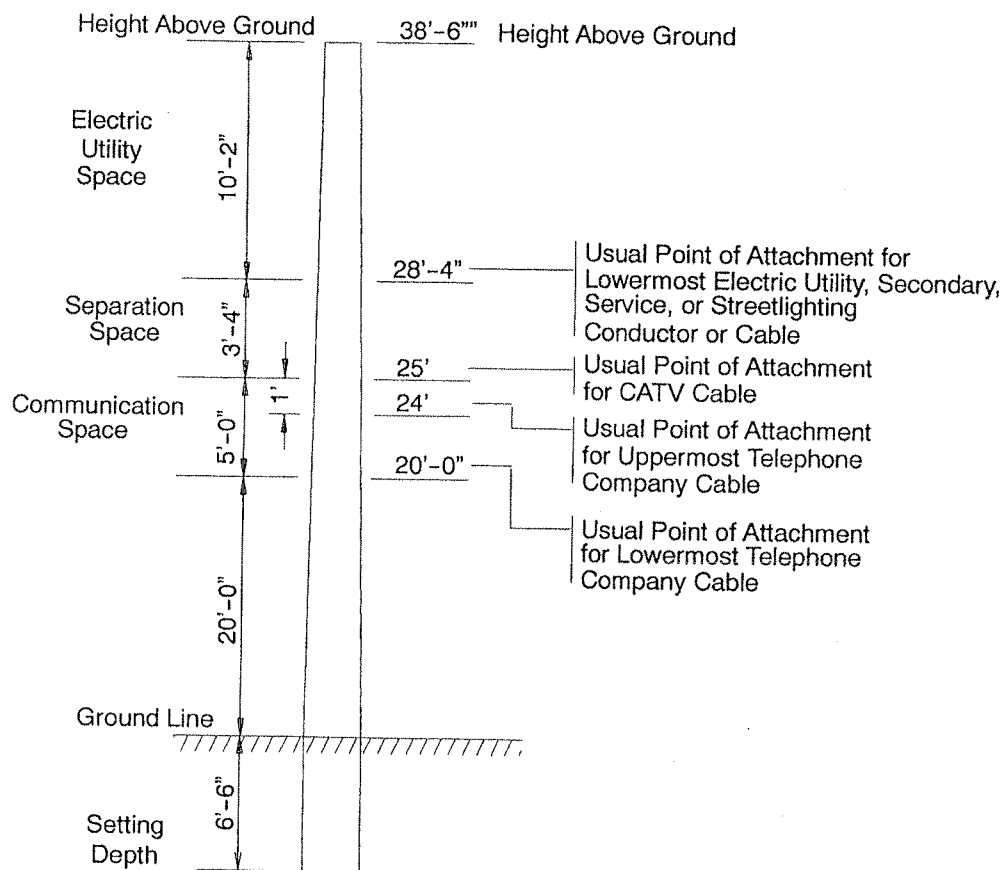


Figure 3 - Space Allocation on the 45-Foot Basic Joint Use Pole

Distribution Construction Standard

© 2007 by PacifiCorp. All rights reserved.

Engineer (D. Asgharian): *DDA*
Standards Manager (G. Lyons): *GL*

Joint Use Pole Space Allocation




22 Mar 07

EU 101
Page 5 of 6

EU 101

5. Poles Taller Than the 45-Foot basic Pole

The company requiring extra pole height pays the extra cost and gets to use the extra height, less the 10% used by the deeper pole hole.
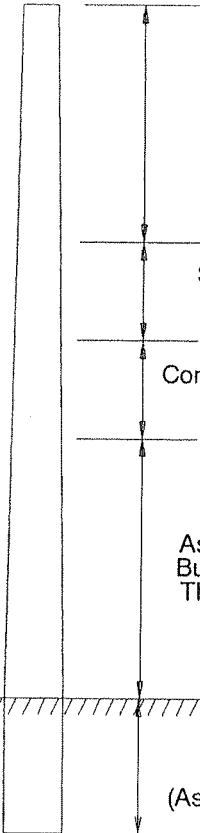
| | | Basic Pole | Taller Than Basic Pole Extra Height Required By | | |
|--|--------------------------------------|------------|--|------------------|-------------------|
| | | | Electric | Commun. | Both |
|  | Electric Utility Space | 10'-2" | 10'-2" + 0.9 L | 10'-2" | 10'-2" |
| | Separation Space | 3'-4" | 3'-4" | 3'-4" | 3'-4" |
| | Communication Space | 5'-0" | 5'-0" | 5'-0" + 0.9 L | 5'-0" |
| | As Required But Not Less Than 20'-0" | 20'-0" | 20'-0" | 20'-0" | 20'-0" + 0.9 L |
| | Setting Depth (As Required) | 6'-6" | 6'-6" +0.1 L | 6'-6" +0.1 L | 6'-6" +0.1 L |
| | Pole Length | 45' | 45' + L | 45' + L | 45' + L |

L = Extra Pole Length

Figure 4 - Space Allocation on Poles Taller Than the 45-Foot Basic Pole



Joint Use—Climbing Space Through Communication Circuits

A. Scope

This standard provides information defining the climbing space requirements for joint use poles through the communication circuit level. Included are communication cables, service drops and vertical runs attached to the pole.

B. General

The climbing space as defined is intended to provide adequate clearances on the pole for safe ascent and descent by line personnel. The climbing space must extend 40 inches above and below the referenced communication—circuit or 48" above and below in California (see Figure 1). If the climbing space is rotated around the pole for continued climbing, the climbing spaces in different quadrants of the pole must overlap.

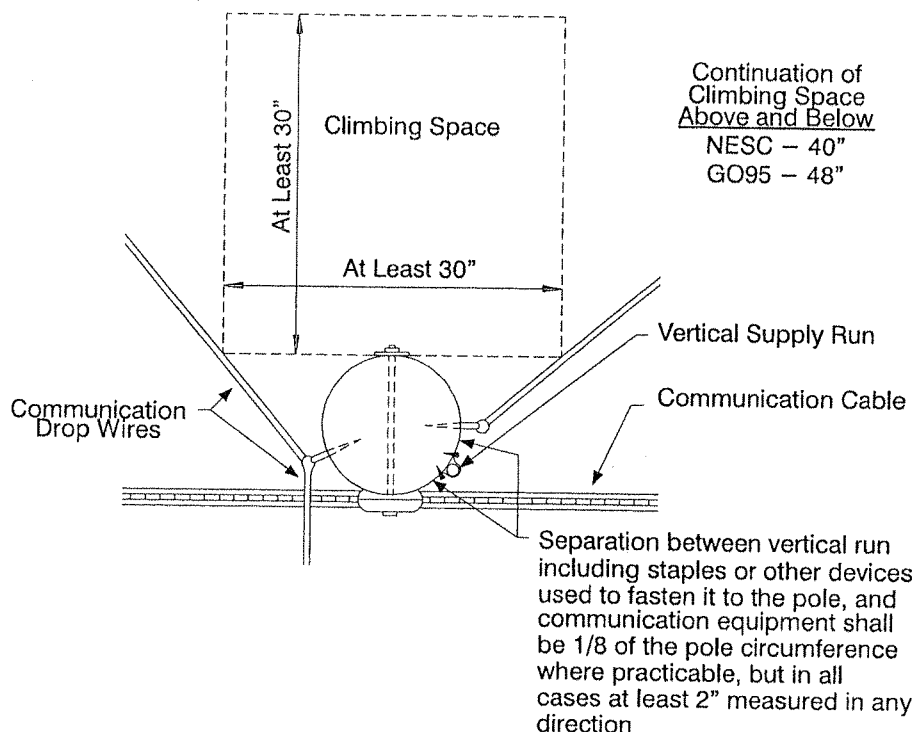


Figure 1 – Climbing Space

Distribution Construction Standard

Engineer (N. J. Johnson):
Distribution Engrg. (D. Horman):
Standards Services (M. Brimhall):

Joint Use Climbing Space Through Communication Circuits



31 May 93

EU 211
Page 1 of 1

Joint Use—Clearances, Communication to Supply Circuits

A. Scope

This standard provides information regarding vertical clearances between PacifiCorp supply circuits and joint use facilities. Included are communication circuits, neutral supports and secondary supply supports.

B. General

The vertical clearances between company supply circuits and other utility attachments are specified in this standard.

1. Vertical Spacing - Crossarms

The vertical spacing requirements between company supply circuits and communication circuits varies depending upon the voltage level and NESC and/or state (California and Washington) jurisdiction (see Figure 1 and Table 1 for clearances.).

2. Vertical Spacing - Attachments to Pole

The vertical spacing requirements between company supply circuits attached to the pole and communication circuits depends upon the supply voltage level, effectively grounded cables and NESC and/or state (California and Washington) jurisdiction (see Figure 2 and Table 2 for clearances).

3. Open Wire Communications Circuits

It is not intended that there be any new joint use poles with open wire communications circuits. Clearance to these circuits is shown because some of this type of construction still exists.

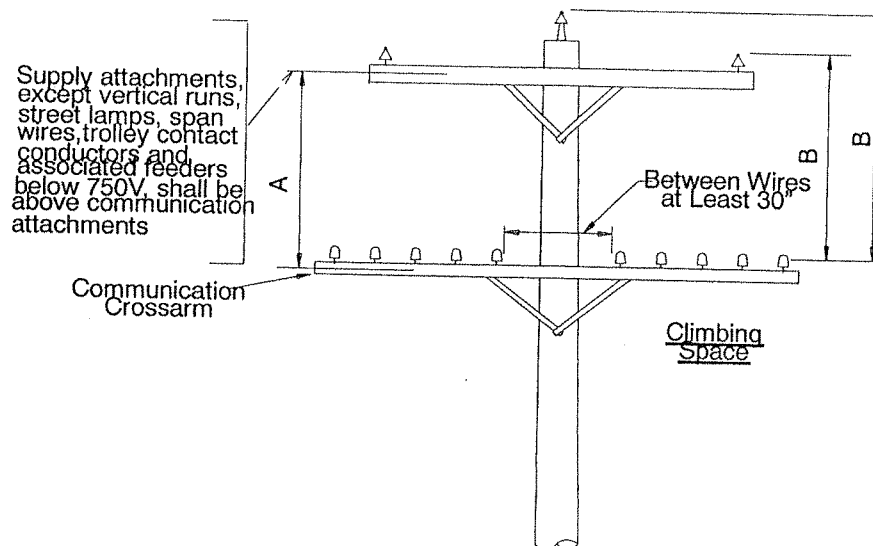


Figure 1 - Vertical Spacing of Crossarms and Circuits, Communication & Supply

Distribution Construction Standard

© 2007 by PacifiCorp. All rights reserved.

Engineer (D. Asgharian): *DDA*
Standards Manager (G. Lyons): *GL*

Joint Use—Clearances, Communication to Supply Circuits



8 Nov 07

EU 221
Page 1 of 4

EU 221

Table 1 - Vertical Clearance Between Supply and Communication Facilities

| Voltage of Supply Circuit | Min. X-arm Spacing (In.) (Dimension A) | Min. Conductor Spacing (In.) (Dimension B) |
|---------------------------|--|--|
| NESC [1] | | |
| 0-8700 | 48 | 40 |
| 8700-50000 | 72 | 60 |
| Washington [2] | | |
| 0-7500 | 48 | 40 |
| Over 7500 | 84 | 84 |
| California [2] | | |
| 0-7500 | 48 | 48 |
| 7500-75000 | 72 | 72 |

- [1] Voltage is to ground if an effectively grounded circuit, otherwise voltage is highest voltage between any two conductors.
- [2] Voltage is highest voltage between any two conductors.

California G. O. 95
exceptions, Dim. A
Rule 92.1B
0-750V supply on racks—A = 72"
Supply cables—A = 48"

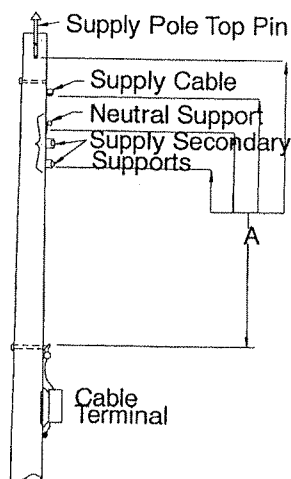


Figure 2 - Vertical Clearances Between Conductors and Noncurrent Carrying Metal Parts of Communication Equipment and Supply Circuits

Table 2 - Vertical Clearances Between Conductors and Noncurrent Carrying Metal Parts of Communication Equipment and Supply Circuits

| Dim. A | Washington | | NESC | | California | |
|-----------|---|-----------------------|---|-----------------------|---|-----------------------|
| | Voltage of Supply [2] Circuit Concerned | Min. Clearance Inches | Voltage of Supply [1] Circuit Concerned | Min. Clearance Inches | Voltage of Supply [2] Circuit Concerned | Min. Clearance Inches |
| | 0- 7500 Over 7500 | 40 84 | 0-8700 Over 8700 | 40 60 | 0-7500 7500-75000 | 48 72 |



EU 221
Page 2 of 4

8 Nov 07

Joint Use—Clearances,
Communication to
Supply Circuits

Distribution
Construction Standard

© 2007 by PacifiCorp. All rights reserved.

Engineer (D. Asgharian): DDA
Standards Manager (G. Lyons): GS

- ① Voltage is to ground if an effectively grounded circuit, otherwise same as ②.
 ② Voltage is highest voltage between any two conductors.

4. Horizontal Spacing

The preferred method of attaching communications cables to poles is to utilize one side of the pole with 12" minimum vertical separation between cables. This allows climbing on the other side of the pole. However, in certain circumstances, PacifiCorp will allow installation of communications cables on both sides of a pole, as long as there is a minimum of 30" horizontal separation between wires for climbing. This separation can be obtained by using fiberglass arms, strong enough to handle physical loads upon them and long enough to provide the needed 30" separation at the point of attachment to the pole (see Figure 1 and Figure 3).

(If Figure 1 is the attachment method being used, 30" horizontal measurements are required between cables. This measurement applies to any cables attached to the crossarm, but must also take into consideration any cable attached directly to the pole.)

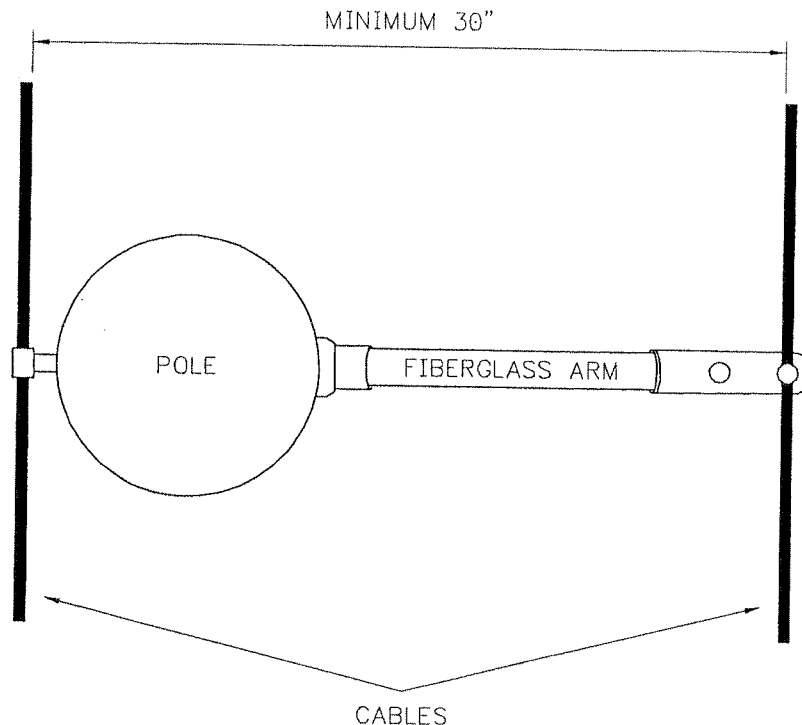


Figure 3 - Horizontal Spacing Using Fiberglass Arm

Distribution Construction Standard

© 2007 by PacifiCorp. All rights reserved.

Engineer (D. Asgharian):

DDA

Standards Manager (G. Lyons):

GS

Joint Use—Clearances, Communication to Supply Circuits



8 Nov 07

EU 221
Page 3 of 4

This page is left blank intentionally.



EU 221
Page 4 of 4

8 Nov 07

**Joint Use—Clearances,
Communication to
Supply Circuits**

**Distribution
Construction Standard**

© 2007 by PacifiCorp. All rights reserved.

Engineer (D. Asgharian): *DDA*
Standards Manager (G. Lyons): *GL*

Joint Use—Clearances, Communication Above Ground, Roadway or Water

A. Scope

This standard provides information regarding the minimum clearance required between joint use facilities attached to PacifiCorp structures and ground, roadways, and waterways.

B. General

The vertical clearances of all facilities attached to PacifiCorp structures must meet or exceed the minimum requirements of the National Electrical Safety Code (ANSI C2, current edition), and any applicable state or local codes and the requirements of the PacifiCorp construction standards. These requirements shall apply to communication circuits, fiber optic lines, cable television circuits, messenger wires, guy wires and any other foreign owned facilities attached to PacifiCorp equipment.

In the event that the owner of a foreign facility is not a public utility company, then the attached facility must also comply with the provisions of the National Electrical Code (NFPA 70).

C. Application

1. Clearances shall be maintained at maximum loading conditions as defined by NESC rule 232.
2. PacifiCorp clearance requirements are found in section DC of the Distribution Construction Standards. PacifiCorp ground clearance requirements are found in section DC 111.
3. In the event of conflicting requirements, the requirement which provides more clearance shall apply.

D. Special Requirements by State

1. Utah

For state and federal highways, the following requirements are to be followed:

- a) At intersections, minimum clearances are the applicable NESC clearance plus 13 feet.
- b) At other points adjacent to or crossing a state highway, minimum clearances are NESC clearances plus 8 feet.
- c) Crossing any public roadway, the minimum ground clearance is 18 feet.

2. Washington

Along or crossing a state or federal highway, 24 feet of ground clearance is required.

EU 231

This page is left blank intentionally.



EU 231
Page 2 of 2

17 Mar 00

**Joint Use—Clearances,
Communication Above
Ground, Roadway or
Water**

**Distribution
Construction Standard**

© 2000 by PacifiCorp. All rights reserved.

Engineer (S. Waddoups):

Stds Team Leader (D. Jones):

Joint Use—Clearances, Communication Equipment to Risers

A. Scope


This standard provides information regarding the location of risers and vertical runs on joint use poles. Included are company owned supply risers, communication risers and ground conductors.


B. General

Risers and vertical runs on joint use poles shall be located on poles so as to minimize congestion, provide adequate climbing space and meet clearance requirements. Whenever practicable, risers and vertical runs shall be located on the 'away from'-traffic side of the pole. If supply and communication risers are required on the same pole, they should be installed in the same quadrant away from the climbing space. For typical arrangement of joint risers, see Figure 1. For preferred arrangements of risers and vertical runs on joint poles, see Figure 2. Supply cable risers shall be installed in approved protective conduit (see standard GC 051). Supply cable carried vertically through communication attachments and supply circuits shall be attached to the pole so as to meet or exceed minimum NESC clearance requirements in all areas (see Figure 3).



**Distribution
Construction Standard**
© 2000 by PacifiCorp. All rights reserved.

Engineer (S. Waddoups): 

Stds Team Leader (D. Jones): 

**Joint Use
Clearances,
Communication
Equipment to Risers**

 **PACIFICORP**
PACIFIC POWER UTAH POWER

17 Mar 00

EU 241
Page 1 of 4