


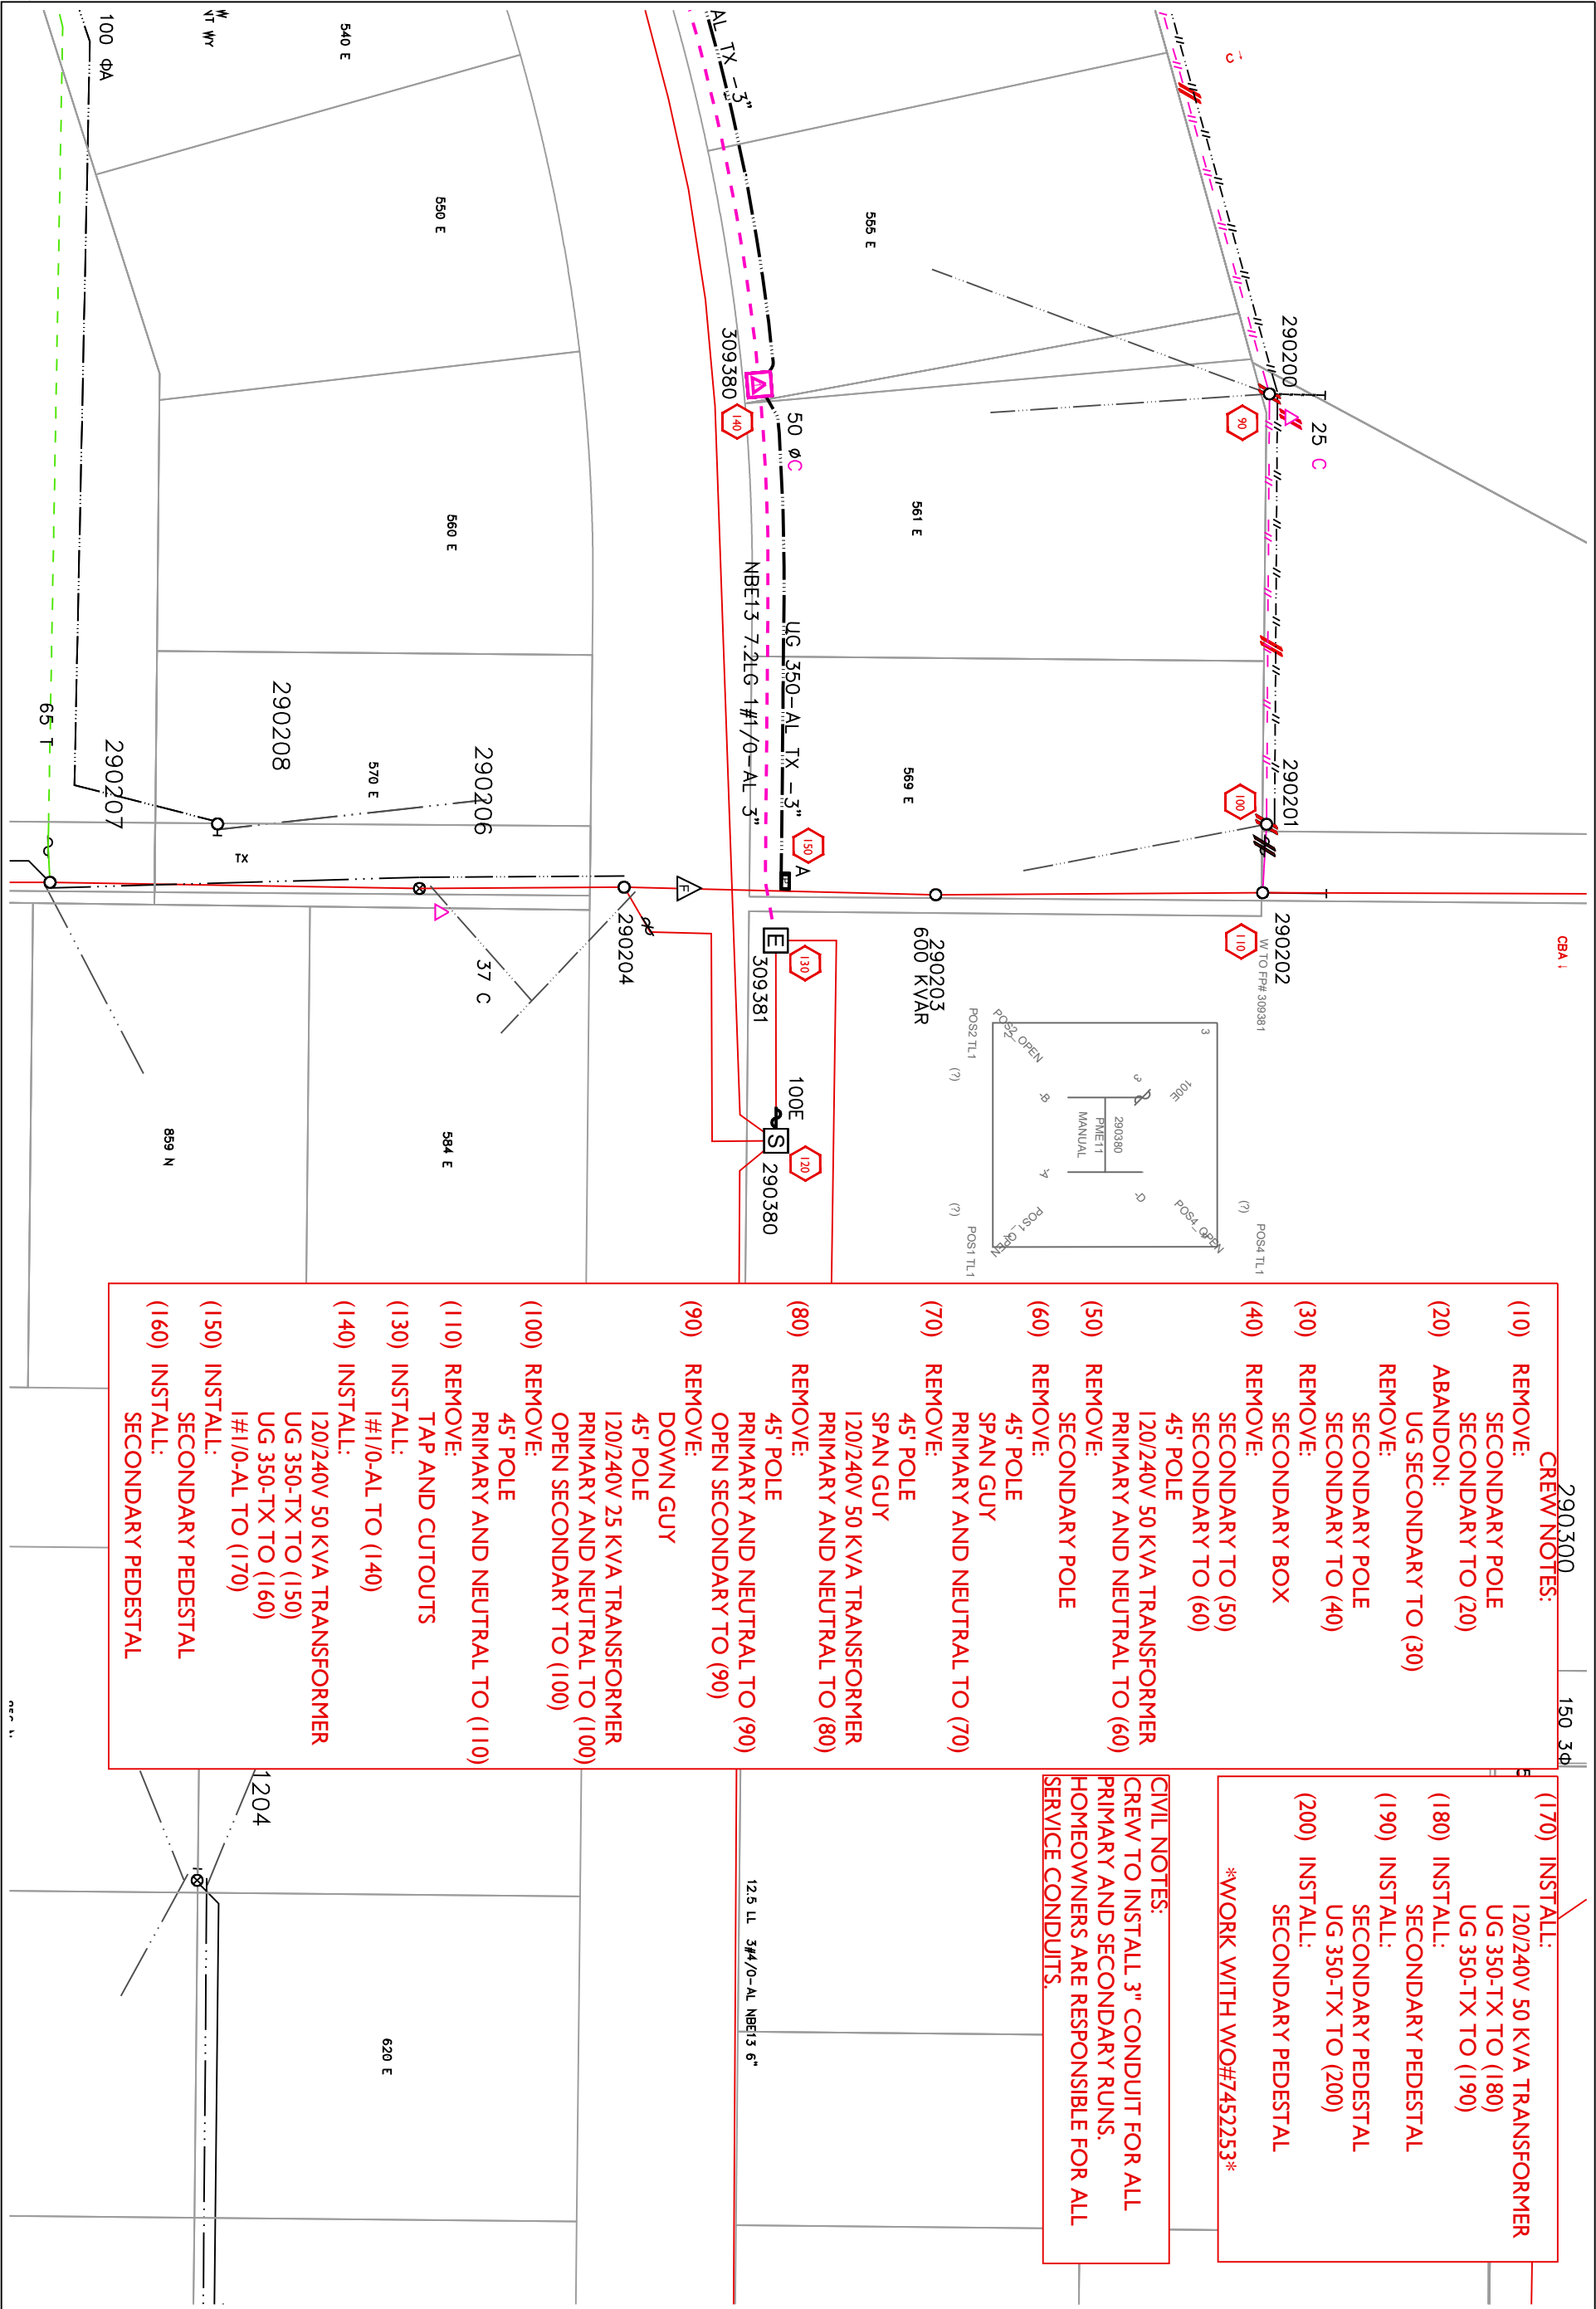

- 290300

CREW NOTES:

(10) REMOVE:
SECONDARY POLE
SECONDARY TO (20)

(20) ABANDON:
UG SECONDARY TO (30)
REMOVE:
SECONDARY POLE
SECONDARY TO (40)

(30) REMOVE:
SECONDARY BOX
SECONDARY TO (50)

(40) REMOVE:
SECONDARY TO (50)
SECONDARY TO (60)
45' POLE
120/240V 50 KVA TRANSFORMER
PRIMARY AND NEUTRAL TO (60)

(50) REMOVE:
SECONDARY POLE

(60) REMOVE:
45' POLE
SPAN GUY
PRIMARY AND NEUTRAL TO (70)

(70) REMOVE:
45' POLE
SPAN GUY
120/240V 50 KVA TRANSFORMER
PRIMARY AND NEUTRAL TO (80)

(80) REMOVE:
45' POLE
PRIMARY AND NEUTRAL TO (90)
OPEN SECONDARY TO (90)

(90) REMOVE:
DOWN GUY
45' POLE
120/240V 25 KVA TRANSFORMER
PRIMARY AND NEUTRAL TO (100)
OPEN SECONDARY TO (100)

(100) REMOVE:
45' POLE
PRIMARY AND NEUTRAL TO (110)
TAP AND CUTOUTS

(110) REMOVE:
TAP AND CUTOUTS

(130) INSTALL:
1#1/0-AL TO (140)

(140) INSTALL:
120/240V 50 KVA TRANSFORMER
UG 350-TX TO (150)
UG 350-TX TO (160)
1#1/0-AL TO (170)

(150) INSTALL:
SECONDARY PEDESTAL

(160) INSTALL:
SECONDARY PEDESTAL
- (170) INSTALL:
120/240V 50 KVA TRANSFORMER
UG 350-TX TO (180)
UG 350-TX TO (190)

(180) INSTALL:
SECONDARY PEDESTAL

(190) INSTALL:
SECONDARY PEDESTAL
UG 350-TX TO (200)

(200) INSTALL:
SECONDARY PEDESTAL

WORK WITH WO#7452253

CIVIL NOTES:
CREW TO INSTALL 3" CONDUIT FOR ALL
PRIMARY AND SECONDARY RUINS.
HOMEOWNERS ARE RESPONSIBLE FOR ALL
SERVICE CONDUITS.

Foreman		Emp #	Job Start Date		 A BERKSHIRE HATHAWAY ENERGY COMPANY		
CC#	WO# / REQ#	Map String	Job Complete Date				
I1441	007401989	I1101001.0			2 OF 2		
Customer : TIMOTHY P WATCHKE Address : 529 E NORTHMONT WAY SALT LAKE CITY, U			Circuit NBE13	Post Jobs RQII Posted	EST ID# P42221	Print Date 7/31/2025	Scale 1" = 50'